



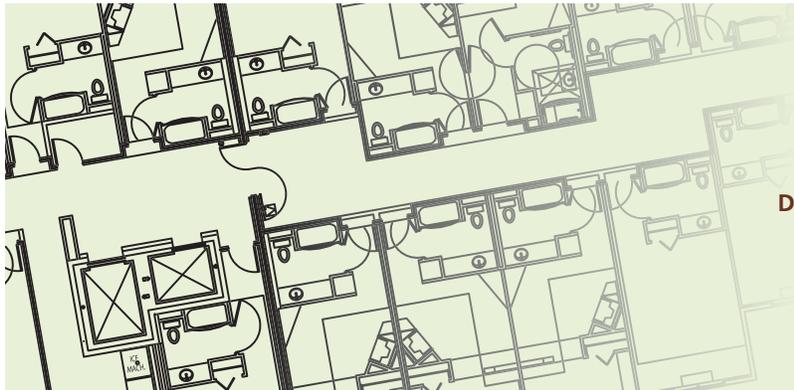

WoodWorksTM
WOOD PRODUCTS COUNCIL

D E S I G N E X A M P L E

Five-Story Wood-Frame Structure over Podium Slab

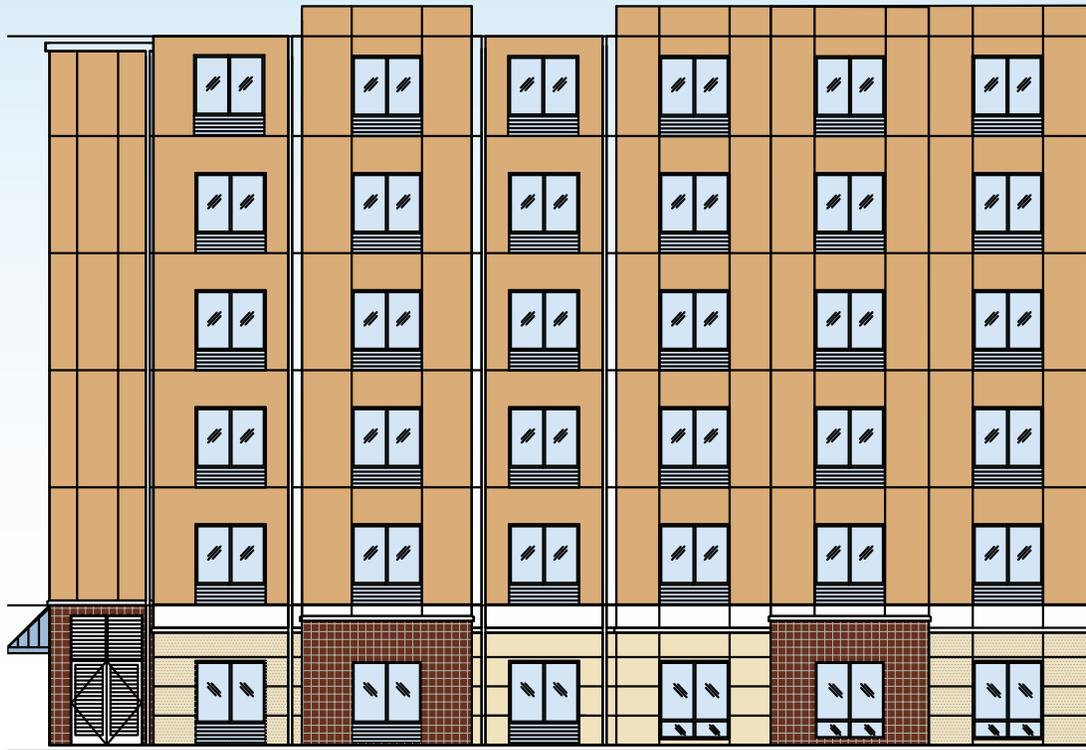

Developed for WoodWorks by
Douglas S. Thompson, PE, SE, SECB
STB Structural Engineers, Inc.
Lake Forest, CA

Free design and engineering support for non-residential and multi-family wood buildings

WoodWorks provides free resources that allow engineers, architects and others to design and build non-residential and multi-family structures out of wood more easily and at less cost. This includes free one-on-one project assistance as well as educational events and online resources such as CAD/REVIT details, case studies, and Continuing Education Units.

For tools and resources related to multi-story wood buildings, visit www.woodworks.org and look under Building Types, Multi-Residential/Mixed-Use.



Five reasons to choose wood for your next project:

Wood typically provides more value—in terms of its beauty, design flexibility and environmental attributes—for less cost than other major building materials, all while meeting fire, safety and other code requirements.

- 1. Wood costs less** – In addition to lower material costs, wood building systems typically cost less to install than other materials. Wood construction is fast, and wood’s relative light weight reduces the need for foundation capacity and associated costs.
- 2. Wood structures meet code** – The *International Building Code* recognizes wood’s safety and structural performance capabilities and allows its use in a wide range of building types, from multi-story condominiums and offices to schools, restaurants, malls and arenas.
- 3. Wood performs well in earthquakes and high winds** – Because wood-frame buildings are lighter and have more repetition and ductility than structures built with other materials, they are very effective at resisting lateral and uplift forces.
- 4. Wood is versatile and adaptable** – Wood’s design flexibility lends itself both to traditional and innovative uses. With the exception of major members that are made to spec off site, wood can be adapted in the field, allowing quick solutions if changes are required. Wood is also well suited to additions and retrofits, and wood systems can be dismantled with relative ease and the materials used elsewhere.
- 5. Using wood helps reduce your environmental impact** – Wood grows naturally and is renewable. Life cycle assessment studies also show that wood buildings have less embodied energy than structures made from steel or concrete, are responsible for less air and water pollution, and have a lighter carbon footprint.

For more information, visit: [woodworks.org](http://www.woodworks.org)

Table of Contents

UPDATE NOTE – In September 2016, updates were made to the following sections: 4a. Stiffness Determinations, 4b. Period Determinations, and 6h. Determine Resisting Moments and Uplift Forces. In November 2017, additional changes were made to 4a. Stiffness Determinations, and 4b. Period Determinations.

PART I – Overview

Overview	4
Codes and Reference Documents Used.....	5
Factors that Influence Design.....	5
Species of Lumber	5
Grade of Lumber	5
Moisture Content and Wood Shrinkage.....	6
Condition of Seasoning	6
Location of Shear Walls	6
Support of Floor Joists.....	7
Given Information	7

PART II – Structural and Non-structural

1. Seismic Height Limitation	10
2. Fire and Life Safety	10
a. Height and Area Allowances.....	10
b. Fire Resistance	11
c. Fire Retardant-Treated Wood	12
3. Vertical Displacement (Shrinkage) in Multi-Level Wood Framing	14
a. Comprehensive Shrinkage Estimation	15
b. Quick Shrinkage Estimation	16

PART III – Seismic Design

4. Two-Stage Design for Seismic Lateral Analysis	20
a. Stiffness Determinations	20
b. Period Determinations	21
c. Design of Flexible Upper Portion	23
d. Design of Rigid Lower Portion	23
5. Seismic Design of Flexible Upper Portion and Rigid Lower Portion	24
a. Seismic Design of Flexible Upper Portion	24
b. Assumption of Flexible Diaphragms.....	30
c. Flexible vs. Rigid Diaphragm Analysis	30
d. Flexible Upper Portion Redundancy Factor.....	31
e. Seismic Design of Rigid Lower Portion	31



6. Shear Wall Design Example.....	31
a. Determination of Lateral Loads to Shear Wall	31
b. Determination of Shear Wall Sheathing and Nailing.....	33
c. Shear Wall Cumulative Overturning Forces.....	33
d. Load Combinations using 2012 IBC	34
e. Load Combinations using 2012 ASCE 7-10.....	34
f. Shear Wall Chord (Boundary) Members.....	35
g. Example Compression Member Capacity Determination.....	39
h. Determine Resisting Moments and Uplift Forces	40
i. Shear Wall Tie-Down System Components	41
7. Considerations with Continuous and Discontinuous Anchor Tie-Downs	45
8. Shear Wall Deflection, Tie-Downs and Take-Up Devices.....	46
a. Continuous Tie-Down Assembly Displacement	46
b. Shear Wall Deflection	51
c. Story Drift Determination.....	54
d. Load Path for Rod Systems	56
e. Proprietary Software for Continuous Tie-Down Systems	58
9. Discontinuous System Considerations and the Overstrength (Ω) Factor.....	58
a. Anchor Forces to Podium Slab	58

PART IV – Wind vs. Seismic Design with Wind Controlling

10. Use of Gypsum Board for Lateral Resistance	60
11. Use of Cooler Nails vs. Screws for Gypsum Board Fastening	61
12. Wind Loading Analysis – Main Wind-Force Resisting System	61
a. Determination of Design Coefficients for Transverse Direction	62
b. Determination of Design Coefficients for Longitudinal Direction.....	64
13. Seismic Loading Analysis.....	66
a. Design Base Shear	66
14. Wind and Seismic Forces to Typical Interior Transverse Wall	67
a. Determination of Shear Wall Fastening	68
b. Determination of Shear Wall Chord (Boundary) Forces and Members	69
c. Determination of Shear Wall Uplift Forces.....	71
15. Wind and Seismic Forces to Typical Interior Corridor Wall.....	72
a. Determination of Shear Wall Fastening	73
b. Determination of Shear Wall Chord (Boundary) Forces and Members	74
c. Determination of Shear Wall Uplift Forces.....	75

Part 1 – Overview

This design example illustrates the seismic and wind design of a hotel that includes five stories of wood-frame construction over a one-story concrete podium slab and is assigned to Seismic Design Category D. The gravity load framing system consists of wood-frame bearing walls for the upper stories and concrete bearing walls for the lower story. The lateral load-resisting system consists of wood-frame shear walls for the upper stories and concrete shear walls for the lower story. Typical building elevation and floor plan of the structure are shown in Figures 2 and 3 respectively. A typical section showing the heights of the structure is shown in Figure 6. The wood roof is framed with pre-manufactured wood trusses. The floor is framed with prefabricated wood I-joists. The floors have a 1-1/2 inch lightweight concrete topping. The roofing is composition shingles.

This design example uses the term “podium slab” which, while not a term defined in the *2012 International Building Code* (IBC) or *2013 California Building Code* (CBC), is included in the commentary to §510.2 in the 2012 IBC (509.2 in the 2009 IBC). Also referred to as *pedestal* or *platform* buildings, this type of construction has a slab and beam system that is designed to support the entire weight of the wood superstructure. Section 510.2 of the 2012 IBC outlines the use of horizontal building separations, which allow a 3-hour fire resistance-rated assembly to be used to create separate buildings for the purposes of allowable height and area. This is similar to the concept used for fire walls.

When designing this type of mid-rise wood-frame structure, there are several unique design elements to consider. The following steps provide a detailed analysis of some of the important seismic requirements of the shear walls per the 2012 IBC and 2013 CBC.

This example is not a complete building design. Many aspects have not been included, specifically the gravity load framing system, and only certain steps of the seismic and wind design related to portions of a selected shear wall have been illustrated. The steps that have been illustrated may be more detailed than what is necessary for an actual building design but are presented in this manner to help the design engineer understand the process.

Disclaimer

The information in this publication, including, without limitation, references to information contained in other publications or made available by other sources (collectively “information”) should not be used or relied upon for any application without competent professional examination and verification of its accuracy, suitability, code compliance and applicability by a licensed engineer, architect or other professional. Neither the Wood Products Council nor its employees, consultants, nor any other individuals or entities who contributed to the information make any warranty, representative or guarantee, expressed or implied, that the information is suitable for any general or particular use, that it is compliant with applicable law, codes or ordinances, or that it is free from infringement of any patent(s); nor do they assume any legal liability or responsibility for the use, application of and/or reference to the information. Anyone making use of the information in any manner assumes all liability arising from such use.



Codes and Reference Documents Used

2012 International Building Code (IBC)

2012 National Design Specification® (NDS®) for Wood Construction – ASD/LRFD

2008 Special Design Provisions for Wind and Seismic (SDPWS-2008)

American Institute of Steel Construction Steel Construction Manual – Thirteenth Edition

2013 California Building Code (CBC)

This design example focuses on the IBC and NDS requirements. Where there is a difference between the IBC and CBC, a comment and reference is made.

Factors That Influence Design

Prior to starting the seismic design of a structure, the following must be considered:

Species of Lumber

The species of lumber used in this design example is Douglas Fir-Larch (DF-L), which is common on the west coast. The author does not intend to imply that this species needs to be used in all areas or for all markets. Species that are both appropriate for this type of construction and locally available vary by region, and also commonly include (among others) Southern Yellow Pine (SYP) and Spruce-Pine-Fir (SPF).

Grade of Lumber

The lower two stories of the wood-frame structure carry significantly higher gravity loads than the upper two stories. One approach is to use a higher grade of lumber for the lower two stories than the upper two stories. This approach can produce designs that yield a consistent wall construction over the height of the building. Another approach would be to choose one grade of lumber for all five wood-frame stories. This approach produces the need to change the size and/or spacing of the studs based on the loading requirements. Sill plate crushing may control stud sizing at lower stories. For simplicity, this design example illustrates the use of one lumber grade for all floor levels.

Figure 1. Typical Grade Stamp



NOTES FOR FIGURE 1:

- a. Certification Mark:** Certifies grading agency quality supervision
- b. Mill Identification:** Firm name, brand or assigned mill number
- c. Grade Designation:** Grade name, number or abbreviation
- d. Species Identification:** Indicates species by individual species or species combination
- e. Condition of Seasoning:** Indicates condition of seasoning at the time of surfacing

Moisture Content and Wood Shrinkage

From a serviceability and performance perspective, the most significant issue related to multi-story wood-frame construction is wood shrinkage—which is impacted by the moisture content (MC) and, more specifically, whether the wood used is “green” or “kiln dried.”

The availability of both types is largely dependent on the region and associated market conditions. Typically, wood used in construction in the U.S. southwest is “green” (S-GRN) and kiln dried (KD) wood is relatively rare, while the opposite is true in other parts of the country. The engineer should consider the availability of kiln dried lumber in the area of the proposed construction. To help designers looking for this information, WoodWorks offers free one-on-one project support as well as a wide range of online resources. For assistance on a project, email help@woodworks.org or visit the WoodWorks website at: <http://www.woodworks.org/project-assistance-map/>.

Condition of Seasoning

There are three levels of wood seasoning (drying), which denotes the moisture content of the lumber at the time of surfacing. The identification “stamps” are as follows:

S-GRN = over 19% moisture content (unseasoned)

S-DRY, KD or KD-HT = 19% maximum moisture content (seasoned)

MC 15 or KD 15 = 15% maximum moisture content

These designations may be found in the grade stamp.

Unseasoned lumber (S-GRN) is manufactured oversized so that when the lumber reaches 19 percent moisture content it will be approximately the same size as the dry (seasoned) size.

Heat treated (HT) lumber is lumber that has been placed in a closed chamber and heated until it attains a minimum core temperature of 56°C for a minimum of 30 minutes.

The word “DRY” indicates that the lumber was either kiln or air dried to a maximum moisture content of 19 percent.

Kiln dried (KD) lumber is lumber that has been seasoned in a chamber to a pre-determined moisture content by applying heat.

Kiln dried heat treated (KD-HT) lumber has been placed in a closed chamber and heated until it achieves a minimum core temperature of 56°C for a minimum of 30 minutes.

Moisture content restrictions apply at time of shipment as well as time of dressing if dressed lumber is involved, and at time of delivery to the buyer unless shipped exposed to the weather.

Engineered wood I-joists were used in this design example; however, given the short span of the floor joists and roof joists, sawn lumber could have been used. In this case, the joist shrinkage perpendicular to grain would need to be included in the overall shrinkage calculation. Also, sawn lumber joists can be supported in joist hangers (see Figure 5) so as not to contribute to the overall building shrinkage. For this design example, sawn lumber is used for the stud-framed walls.

For further explanation of moisture content and wood shrinkage, see §3.

Location of Shear Walls

The lateral force-resisting system in this design example uses both interior and exterior walls for shear walls (see Figure 3). The seismic force-resisting system for the transverse direction (north-south) utilizes the interior walls between the hotel guest rooms. A seismic design of a selected interior shear wall in the transverse direction is illustrated in this design example. The seismic force-resisting system for the longitudinal direction (east-west) utilizes the long interior corridor walls located at the center of the structure, with shear walls on both sides of the corridor in addition to shear walls on the exterior walls and shear walls at the bathroom walls.



Related to the lateral force-resisting system in the longitudinal direction for structures similar to this design example, it is recognized that some structural engineers may only utilize the interior corridor walls and not place shear walls on the exterior walls for similar building configurations. Engineers using such layouts have used rigid diaphragm analysis to distribute lateral forces to the shear walls and followed the requirements of SDPWS 2008 §4.2.5.1.1 for Open Front Structures. While the code does not explicitly prohibit the elimination of exterior shear walls for wood-frame structures, the Structural Engineers Association of California (SEAOC) in the 2012 IBC SEAOC Structural/Seismic Design Manual, Volume 2 has recommended that designers not remove all shear walls from an exterior wall line without careful consideration of the horizontal diaphragm deflections and overall building performance. In SDPWS 2015 §4.2.5.2, the provisions for open front diaphragms have been clarified to include some design considerations and reiterate that ASCE 7 story drift requirements for seismic design forces apply to all edges of the structure.

Support of Floor Joists

This design example uses balloon framing. The floor joists are supported in joist hangers hung from the top plates (see Figure 5). The wall studs and posts have a simple span between the top of the sole plate and the bottom of the lower top plate.

For wood-frame structures built with regular platform construction, the floor joists are supported by direct bearing onto the top plate(s) (see Figure 5A).

Given Information

Loading Assumptions:

ROOF WEIGHTS:

Roofing + re-roof	5.0 psf
Sheathing	3.0
Trusses + blocking	2.0
Insulation + sprinklers	2.0
Ceiling + misc.	15.0
Beams	1.0
Dead load	28.0 psf
Live load	20.0 psf

FLOOR WEIGHTS:

Flooring	1.0 psf
Lt. wt. concrete	14.0
Sheathing	2.5
I-joist + blocking	4.0
Ceiling + misc.	7.0
Beams	1.5
Dead load	30.0 psf
Live load	40.0 psf

Interior and exterior wall weights have not been included in the above loads; they have been included in the diaphragm weights shown below. Typical interior and exterior partition weights can vary between 10 psf and 20 psf depending on room sizes, number of layers of gypsum board on walls, etc.

Weights of respective diaphragm levels, including tributary exterior and interior walls:

FLEXIBLE UPPER PORTION

W_{roof}	= 587 k
$W_{\text{6th floor}}$	= 639 k
$W_{\text{5th floor}}$	= 647 k
$W_{\text{4th floor}}$	= 647 k
$W_{\text{3rd floor}}$	= 647 k
W	= 3,167 k

RIGID LOWER PORTION:

W_{upper}	= 3,167 k
$W_{\text{2nd floor}}$	= 2,632 k
W	= 5,799 k

Weights of roof diaphragms are typically determined by taking one half the height of the walls from the fifth floor to the roof. Weights of floor diaphragms are typically determined by taking one-half of the walls above and below for the fifth, fourth and third floor diaphragms. The weights of all walls, including interior non-bearing partitions, are included in the respective weights of the various levels. The weight of parapets (where they occur) has been included in the roof weight.

Structural Material Assumptions:

- The roof is 1/2-inch-thick DOC PS 1 or DOC PS 2-rated sheathing, 32/16 span rating with Exposure I glue.
- The floor is 23/32-inch-thick DOC PS 1 or DOC PS 2-rated Sturd I Floor 24 inches o.c. rating, 48/24 span rating with Exposure I glue.
- DOC PS 1 and DOC PS 2 are the U.S. Department of Commerce (DOC) Prescriptive and Performance-based standards for plywood and oriented strand board (OSB), respectively.
- Wall framing is a modified balloon framing where the joists hang from the walls in joist hangers (see Figure 5).

FRAMING LUMBER FOR STUDS AND POSTS ARE DOUGLAS FIR-LARCH NO. 1 GRADE:

NDS Table 4A

$$F_b = 1,450 \text{ psi}$$

$$F_c = 1,500 \text{ psi}$$

$$F_t = 1,500 \text{ psi}$$

$$E = 1,700,000 \text{ psi}$$

$$E_{\min} = 620,000 \text{ psi}$$

$$C_m = 1.0$$

$$C_t = 1.0$$

Fastener Assumptions:

Common wire nails are used for shear walls, diaphragms and straps. When specifying nails on a project, specification of the penny weight, type, diameter and length (example 10d common = 0.148-inch x 3-inch) is recommended.

The IBC, NDS and SDPWS-2008 list values for shear walls and diaphragms. For values using nail and sheathing thickness not listed in the IBC and NDS/SDPWS, the engineer can also consider using the values listed in *International Code Council-Evaluation Service (ICC-ES) Report ESR-1539* from the International Staple, Nail and Tool Association (ISANTA). This report can be downloaded from ISANTA's website at <http://www.isanta.org> or from the International ICC-ES website at <http://www.icc-es.org>.

Heights and Areas Code Study Assumptions:

Using the special design provision from 2012 IBC 510.2, this design utilizes a 3-hour fire separation at the first level above grade. This horizontal separation creates two buildings for the purposes of fire and life safety. The structure is also equipped throughout with an NFPA 13 sprinkler system which permits an additional story of construction.

LOWER STRUCTURE:

IBC 510.2 & IBC Table 503

Building Type – IA

Occupancies – S-2, B, E, A-2

Table 503 allowable height and area – UL

Actual height – 12 feet



UPPER STRUCTURE:

IBC Table 503

Building Type – IIIA

Occupancy – R-2

Table 503 allowable height – 65 feet and 4 stories

Increased allowable height – 85 feet and 5 stories (see 2a below)

Table 503 allowable area – 24,000 square feet

Actual area – 12,000 square feet/floor


Figure 2. Building Elevation



Note for Figure 2:

See Figure 3 for building plan dimensions and Figure 6 for building height dimensions.

Figure 3. Typical Floor Plan

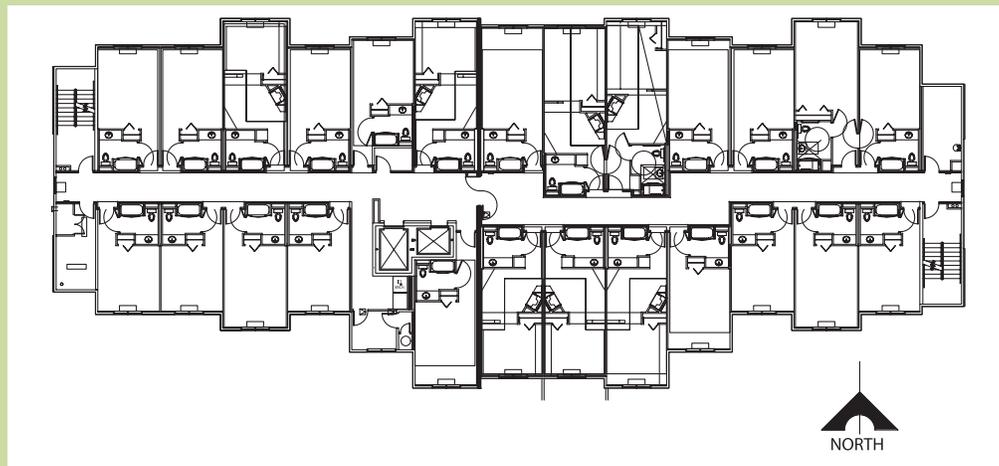

Note for Figure 3:

In Figure 3, the prefabricated wood I-joists run east-west spanning to the wood-bearing walls separating the hotel guest units running north-south at 13 feet o.c. The floor area is 12,000 square feet.

1. Seismic Height Limitation

The heights of the floors and roof are shown in Figure 6.

MAXIMUM HEIGHT OF STRUCTURE:

ASCE 7-10 Table 12.2.1

Table 12.2.1 of ASCE 7-10 lists the maximum height of a structure, measured from its base, related to the seismic force-resisting system (SFRS) and the Seismic Design Category (SDC). Section 11.2 defines the *base* of the structure as “the level at which horizontal seismic ground motions are considered to be imparted on the structure.”

The height of the wood-frame building is measured from the top of the podium slab to the average roof sheathing elevation, as described in the ASCE 7-10 §11.2 definition for “Structural Height.” Due to the rigidity of the concrete podium, the podium slab can be used as the base for the light-framed walls sheathed with wood structural panels. Therefore:

The height limit in SDC D, E and F is 65 feet

The average (mean) height of the structure is 50 feet

65 > 50 *Okay*

2. Fire and Life Safety

2a. Height and Area Allowances

BUILDING HEIGHT:

IBC 504

Increased height = 85 ft and 5 stories

IBC 504.2

The portion of the building below the horizontal assembly is not limited in height or area because it is of Type I construction. The area above the podium is going to be 5 stories and a total of 62 feet above grade, but IBC Table 503 limits the number of stories to 4 and the total height to 65 feet. IBC 504.2 allows an increase of one story and 20 feet in height for most occupancies, R-2 included, when the building is equipped with an NFPA 13 sprinkler system throughout. Because the upper structure is a residential occupancy, an NFPA 13R system may have been considered, but the use of such a sprinkler system limits the overall height to 4 stories and 60 feet and would therefore not have been appropriate for this application.

MEZZANINE:

IBC 505

An additional level can be added by designing a mezzanine into the project. IBC 505 indicates that a mezzanine can be up to one third of the floor area of the room or space above which it is located. It is not counted in the allowable building area; nor is it considered a story. However, it does need to be considered in the fire area outlined in Chapter 9 of the IBC.

BUILDING AREA:

IBC 506 & CBC 506

Increased area = 24,000 ft²* per floor

IBC 506.3

Maximum building area = 3x increased allowable area = 72,000 ft²

IBC 506.4

**No frontage increase per 506.2 is used in this example. CBC does not allow both height and area increases simultaneously for use of NFPA 13 sprinklers.*



The allowable floor area per Table 503 (24,000 square feet) is more than sufficient to accommodate this design with only 12,000 square feet of R-2 occupancy per floor. However, in many instances, an increase in allowable area is required. IBC 506 allows the areas set in Table 503 to be increased based on frontage area (allowing increased accessibility in a fire) and the use of sprinklers. An NFPA 13 sprinkler system can increase the allowable area for multi-story applications by up to three times per equation 5-1 and IBC 506.3. The IBC allows both a height and area increase simultaneously with the use of sprinklers; however, the CBC limits the allowable increase to height or area, but not both. In this example, no area increase was necessary, so this was not an issue. In projects where desired floor area exceeds these allowances, fire walls are used to partition the building. In podium construction, fire walls used in the upper portion of the structure need to be vertically continuous and can terminate at the 3-hour horizontal assembly.

IBC 506.4.1 also outlines a total building area maximum that needs to be considered in addition to the floor area maximum.

HORIZONTAL SEPARATION:

510.2 & 510.4

Using the special provision in IBC 510.2, the upper and lower “buildings” are required to be separated by a horizontal assembly with a fire resistance rating of not less than 3 hours. If the first story above grade only contains parking, then special provision IBC 510.4, which allows a heavy timber podium, may be an option where the fire resistance rating of the horizontal assembly must meet the requirements for occupancy separations in IBC 508.4, which is 2 hours for an R-2 occupancy above an S-2 occupancy as described in this special provision.

2b. Fire Resistance

IBC Table 720.1(2)

There are several ways to achieve a fire rating for a floor or wall assembly. IBC/CBC §703 outlines various methods that include tested assemblies in accordance with ASTM E119, deemed to comply with tables in §721 of the 2012 IBC (§720 of the 2009 IBC), and the component additive method in §722 of the 2012 IBC (§721 of the 2009 IBC).

Fire-rated assemblies can be found in a number of sources including the IBC, the Underwriters Laboratories (UL) *Fire Resistance-Rated Systems and Products*, the UL *Fire Resistance Directory*, and the Gypsum Association's *Fire Resistance Design Manual*.

Table 721.1(2) of the IBC lists prescriptive assemblies and includes fire ratings for various wall construction types. Footnote ‘m’ of the table requires that, for studs with a slenderness ratio, l_e/d , greater than 33, the design stress shall be reduced to 78 percent of allowable F'_c . For studs with a slenderness ratio, l_e/d , not exceeding 33, the design stress shall be reduced to 78 percent of the adjusted stress F'_c calculated for studs having a slenderness ratio l_e/d of 33.

The American Wood Council (AWC) has tested a number of wood-frame fire-rated assemblies, which have been added to Table 721.1(2). Footnote “m” does not apply to these assemblies because the walls were tested at 100% of full design load. The AWC publication DCA3 (which can be downloaded at www.awc.org) provides details on these assemblies that do not require the 78 percent reduction.

DETERMINATION OF C_p :

NDS-12 3.3.3.2

When studs have gypsum sheathing or structural panel sheathing on *both* sides of the studs and posts, where the compressive edges are held in line, C_L may be assumed to be 1.0.

$l_e = l_u$ = the clear height of the studs

This design example has sheathing on both sides, therefore $C_L = 1.0$.

However, when a sound wall is used and the studs are staggered where one edge of the stud does not have its compressive edge held in line, C_L needs to be calculated. For this loading condition, the effective unbraced length ℓ_e for the studs and posts is listed in NDS-12 Table 3.3.3 as follows:

For a 10-foot, 0-inch floor-to-floor height with a 2x4 sole plate with a 4x4 top plate:

$$\frac{\ell_u}{d} = \frac{114 \text{ in}}{3.5 \text{ in}} = 33 > 7$$

Therefore:

$$\ell_e = 1.631\ell_u + 3d$$

Solving for $\ell_e/d = 33$ yields the following stud and post lengths for the footnote 'm' reduction in F'_c :

For 4x studs and posts:

$$\ell_u > 5\text{-ft } 4\text{-in}$$

For 6x studs and posts:

$$\ell_u > 8\text{-ft } 5\text{-in}$$

Since most wall heights for new buildings are 9 to 10 feet, this reduction in F'_c is basically applied to all bearing walls in a fire-rated wall.

It should be noted that this is an IBC requirement and not an NDS requirement.

2c. Fire Retardant-Treated Wood (FRTW)

IBC §602.3

This wood-frame structure exceeds the limits for Type V construction. To have five stories of light wood-frame construction, the code requires that the building be Type III. Type III construction requires the exterior walls to be constructed with noncombustible materials. As an exception to using noncombustible construction, §602.3 of the IBC states that fire retardant-treated wood (FRTW) framing complying with IBC §2303.2 is permitted for exterior wall assemblies with ratings of two hours or less, basically allowing wood-frame construction for many structures where noncombustible materials would otherwise be required.

The FRTW must comply with conditions in IBC §2303.2 and 2304.9.5 as follows:

1) LABELING

IBC §2303.2.4

Fire retardant-treated lumber and wood structural panels must be labeled and contain the following items:

- A. Identification mark of the approved agency
- B. Identification of the treating manufacturer
- C. Name of the fire retardant treatment
- D. Species of the wood treated
- E. Flame spread and smoke-developed index
- F. Method of drying after treatment
- G. Conformance with appropriate standards

If exposed to weather, damp or wet conditions, it must also include the words "No increase in the listed classification when subjected to the Standard Rain Test."




Sample labels for solid sawn framing lumber and plywood are shown in Figure 4. It should be noted that FRTW sheathing is only available in plywood; the amount of resins and waxes in oriented strand board (OSB) is too high for the treatment process.

Some treated wood suppliers require the untreated wood to be shipped to their plant (from the framing contractor) for treatment, then shipped to the site.

Some suppliers stock most “sawn lumber” (2x, 3x and 4x) for immediate shipping.

Treatment adds about 50 percent to the cost of the material for interior and 80 percent for exterior applications.

Figure 4.
Sample Labels
for FRTW

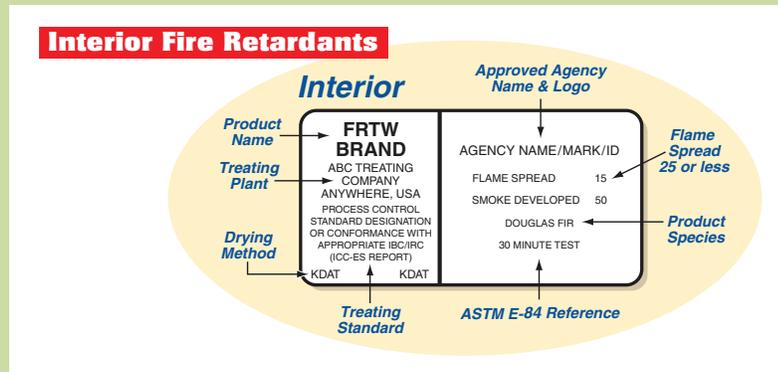

2) STRENGTH ADJUSTMENTS

IBC §2303.2.5

The IBC requires that lumber design values be adjusted for the treatment and take into account the anticipated temperatures and humidity. Each manufacturer must publish the adjustment factors for service temperatures (not less than 80°F) and for roof-framing members (elevated temperatures). The adjustment factors vary from manufacturer to manufacturer, and should be obtained from the product evaluation report. A sample of two manufacturers’ strength adjustments are shown in Table 1.

Note that an additional load factor for incising may also be necessary (C_i) that is not included in the manufacturer provided reduction factors. Incising is dependent on both species and size of the treated material, in addition to treatment formulation. For this example, the 2x and 3x Douglas Fir-Larch studs will not require incising and therefore the incising factor is not used.

Table 1. Sample Strength Reduction Factors for FRTW

Design Property	FRTW Brand A			FRTW Brand B		
	Douglas Fir-Larch	Southern Pine	Spruce-Pine-Fir	Douglas Fir-Larch	Southern Pine	Spruce-Pine-Fir
F_b	0.97	0.91	0.88	0.90	0.89	0.89
F_t	0.95	0.88	0.83	0.87	0.92	0.87
$F_{c\parallel}$	1.00	0.94	0.94	0.91	0.94	0.91
F_v	0.96	0.95	0.93	0.94	0.95	0.94
E	0.96	0.95	0.94	0.98	0.98	0.98
$F_{c\perp}$	0.95	0.95	0.95			
Fasteners	0.90	0.90	0.90	0.92	0.92	0.92

3) EXPOSURE TO WEATHER

IBC §2303.2.6

When FRTW is exposed to weather, damp or wet conditions, the identifying label needs to indicate "EXTERIOR." For this example, all of the wood framing is within the building envelope; therefore, exterior-rated FRTW is not required.

4) FASTENERS

IBC §2304.9.5.4

Fasteners (including nuts and washers) in fire retardant-treated wood used in interior locations shall be in accordance with the manufacturer's recommendations. Fasteners in contact with treated wood need to meet this requirement. Rods in the tie-down system pass through an oversized hole in the wood and do not need to meet this requirement.

5) CUTTING AND NOTCHING

Treated lumber must not be ripped or milled as this will invalidate the flame spread. However, where FRTW joists or rafters are ripped for drainage conditions and FRTW plywood is placed on top of the ripped edge, this is considered acceptable.

End cuts and holes are usually not permitted; check the product evaluation report for requirements.

3. Vertical Displacement (Shrinkage) in Multi-Level Wood Framing

IBC §2303.7

Vertical displacement can be a challenge in multi-level wood framing unless special considerations are accounted for during design and construction. Vertical displacement may be caused by one or a combination of the following:

WOOD SHRINKAGE

Both the IBC and NDS require that consideration be given to the effects of cross-grain dimensional changes (shrinkage) when lumber is fabricated in a green condition. In addition, IBC §2304.3.3 requires that wood walls and bearing partitions supporting more than two floors and a roof be analyzed for shrinkage of the wood framing, and that possible adverse effects on the structure be satisfactorily addressed and solutions be provided to the building official.

The total shrinkage in wood-frame buildings can be calculated by summing the estimated shrinkage of the *horizontal* lumber members in walls and floors (wall plates, sills and floor joists). Most of the shrinkage is cross grain. The amount of shrinkage parallel to grain (length of studs) is approximately $\frac{1}{40}$ of the shrinkage perpendicular to grain (cross grain) and can be neglected.

Resources for calculating shrinkage:

- A free shrinkage calculator can be downloaded from the Western Wood Products Association website at: www2.wwpa.org.
- More information on shrinkage is available in the American Wood Council's *ASD/LRFD Manual for Engineered Wood Construction*, 2012 Edition, which is available at: <http://www.awc.org/standards/nds/2012.php>.

This case study illustrates two methods for determining the amount of wood shrinkage (as follows).



3a. Comprehensive Shrinkage Estimation

For a dimensional change with the moisture content limits of 6 to 14 percent, the formula is:

$$S = D_i [C_T(M_F - M_i)]$$

Where:

S = shrinkage (in inches)

D_i = initial dimension (in inches)

C_T = dimension change coefficient, tangential direction

$C_T = 0.00319$ for Douglas Fir-Larch

$C_T = 0.00323$ for Hem-Fir

$C_T = 0.00263$ for Spruce-Pine-Fir

M_F = final moisture content (%)

M_i = initial moisture content (%)

The formulas are from the *Wood Handbook: Wood as an Engineering Material and Dimensional Stability of Western Lumber Products*.

For a dimension change with moisture content limits greater than 6 to 14 percent where one of the values is outside of those limits, the formula is:

$$S = \frac{D_i (M_F - M_i)}{\frac{30 (100)}{S_T} - 30 + M_i}$$

Where:

S = shrinkage (in inches)

D_i = initial dimension (in inches)

S_T = tangential shrinkage (%) from green to oven dry

$S_T = 7.775$ for Douglas Fir-Larch

M_F = final moisture content (%)

M_i = initial moisture content (%)

The final moisture content (M_F) for a building is referred to as the equilibrium moisture content (EMC). The final EMC can be higher in coastal areas and lower in inland or desert areas. These ranges are normally from 6 to 15 percent (low to high). The WWPA has downloadable documents listing EMC for all major U.S. cities for each month of the year. At the web address after login, click "Shrinkage" followed by "EMC Charts" (free user login with password is required): www2.wwpa.org/Shrinkage/EMCUSLocations1997/tabid/888/Default.aspx

The EMC can be calculated with this formula:

$$EMC = \frac{1800}{W} \left[\frac{KH}{1-KH} + \frac{(K_1KH + 2K_1K_2K^2H^2)}{(1 + K_1KH + K_1K_2K^2H^2)} \right]$$

Where:

$$W = 330 + (0.452)T + (0.00415)T^2$$

$$K = 0.791 + (0.000463)T - (0.000000844)T^2$$

H = relative humidity (%)

$$K_1 = 6.34 + (0.000775)T - (0.0000935)T^2$$

$$K_2 = 1.09 + (0.0284)T - (0.0000904)T^2$$

T = temperature (°F)

For this design example, a final moisture content M_F (EMC) of 12.0 percent is used.

Project specifications call for all top plates and sill (sole) plates to be Douglas Fir-Larch "kiln dried" (KD) or "surfaced dried" (S-Dry). Kiln dried lumber or surfaced dried has a maximum moisture content of 19 percent and an average of 15 percent.

It might be more realistic to use a lower number than 19 percent in the calculation so as to not overestimate the shrinkage.

Typical floor framing has a 4x4 top plate and a 2x4 sole plate (see Figure 5).

Find the individual shrinkage of the two members:

DETERMINE SHRINKAGE OF 4X4 TOP PLATE:

Since our initial MC (M_i) is 19 percent and the final MC (M_F) is 12 percent, the equation is:

$$S = \frac{D_i (M_F - M_i)}{\frac{30 (100)}{S_T} - 30 + M_i} = \frac{3.5 (12 - 19)}{\frac{30 (100)}{7.775} - 30 + 19} = -0.065 \text{ in}$$

The final size of our 4x4 is:

$$3.5 - 0.065 = 3.435 \text{ in}$$

3b. Quick Shrinkage Estimation

A close approximation that is much more easily used to determine amount of shrinkage is:

$$S = CD_i (M_F - M_i)$$

Where:

S = shrinkage (inches)

C = average shrinkage constant

C = 0.002

M_F = final moisture content (%)

M_i = initial moisture content (%)



DETERMINE SHRINKAGE OF 4X4 TOP PLATE:

Since our initial MC (M_i) is 19 percent and the final MC (M_f) is 12 percent, the equation is:

$$S = CD_i (M_f - M_i) = 0.002 \times 3.5 (12-19) = -0.049 \text{ in}$$

The final size of our 4x4 is:

$$3.5 - 0.049 = 3.451 \text{ in}$$


Note that this quick estimation is within 0.5 percent of the actual calculated dimension of 3.435 inches using the comprehensive formulas.

$$S = CD_i (M_f - M_i) = 0.002 \times 1.5 (12-19) = -0.021 \text{ in}$$

DETERMINE SHRINKAGE OF 2X4 SOLE PLATE:

$$S = CD_i (M_f - M_i) = 0.002 \times 1.5 (12 - 19) = -0.021 \text{ in}$$

Figure 5. Typical Floor Framing at Wall

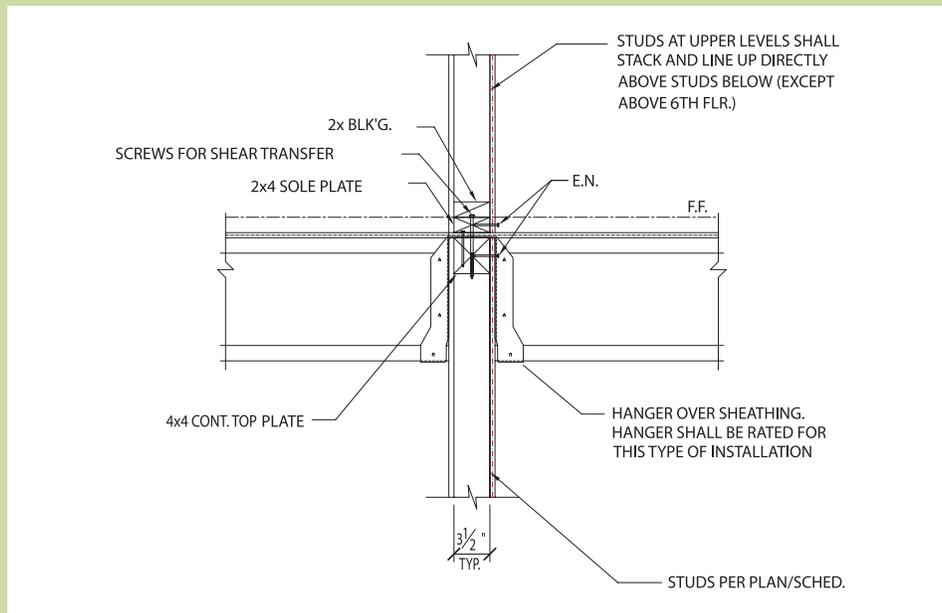


Notes for Figure 5:

1. Blocking above the sole plate is to provide a nailing surface for the finishes. An alternative detail could use two sole plates, but this will increase shrinkage amounts for the building.
2. Web stiffeners at joist hangers may be required depending on joist size and manufacturer.
3. Hangers for the floor joist are installed over the sheathing (gypsum, plywood or OSB) and must be rated/approved for this installation (e.g., Technical Bulletin from joist hanger manufacturer listing reduced allowable hanger loads).
4. This detail uses a 4x4 top plate. Use of double 2x plates (not depicted) is also common.

Total shrinkage per floor level with the 4x4 top plate and 2x4 sole plate:

$$S = 0.049 + 0.021 = 0.07 \text{ in}$$

Figure 5A. Typical Platform Floor Framing at Wall Using Sawn Joists

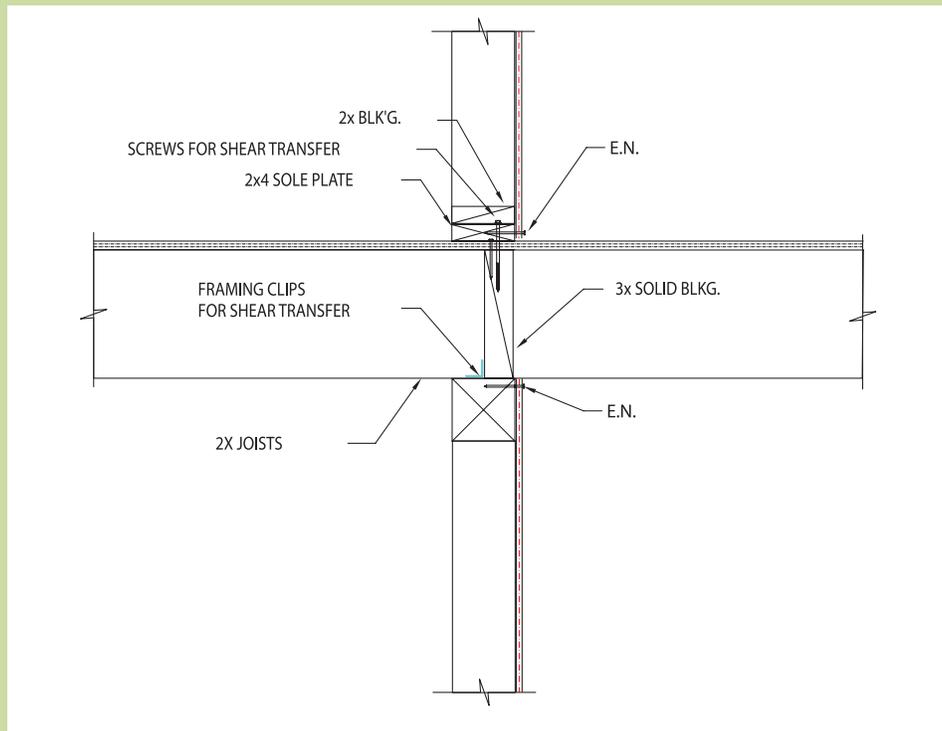

EXAMPLE CALCULATION

DETERMINE SHRINKAGE OF SAWN JOISTS WITH PLATFORM FRAMING (Figure 5A):

$$S = CD_i (M_F - M_i) = 0.002 \times 11.25 (12-19) = -0.158 \text{ in}$$

Total shrinkage per floor level with the 4x4 top plate, 2x12 sawn joists and 2x4 sole plate:

$$S = 0.049 + 0.021 + 0.158 = 0.228 \text{ in}$$

SETTLEMENT UNDER CONSTRUCTION GAPS (Consolidation):

Small gaps can occur between plates and studs, caused by (among other things) mis-cuts (short studs) and the lack of square-cut ends. These gaps can account for up to 1/8 inch per story, where “perfect” workmanship would be 0 inches and a more “sloppy” workmanship would be 1/8 inch. This design example factors in gaps of 1/10 inch per floor.



DEFORMATION UNDER SUSTAINED LOADING:

Wood beams that support walls can creep from the sustained loading. The “rate” of creep is higher for beams that are loaded while at higher moisture contents. Where total deflection under long-term loading must be limited, NDS 3.5.2 recommends the use of a time dependent deformation (creep) factor of between 1.5 and 2.0.

Table 2. Vertical Displacements

Level	Vertical Displacement		Design Displacement (in)
	Per Level	Cumulative	
Roof	0.170	0.85	7/8
6th Floor	0.170	0.68	3/4
5th Floor	0.170	0.51	5/8
4th Floor	0.170	0.34	3/8
3rd Floor	0.170	0.17	1/4

Where: Shrinkage of 0.07 inch + settlement of 0.10 inch = 0.170 inch

METHODS TO REDUCE VERTICAL DISPLACEMENT:

1. Use kiln-dried plates (MC < 19%) or even MC15 (MC < 15%) lumber or engineered lumber for plates.
2. Consider a single top plate instead of double top plate.
3. Consider balloon framing or a modified balloon framing.
4. Place floor joists in metal hangers bearing on beams or top plates instead of bearing on the top plates.
5. Improper storage of the material stock on site can negate all design and planning. Lumber should be kept away from moisture sources and rain.

METHODS TO ACCOUNT FOR VERTICAL DISPLACEMENT:

1. Use continuous tie-down systems with shrinkage compensating devices in shear walls.
2. Architectural finish details near the floor lines need to account for vertical displacement.
3. Provide a 1/8-inch gap between window and door tops to the framing lumber.

Part III – Seismic Design

4. Two-Stage Design for Lateral Analysis

ASCE 7-10 §12.2.3.2

The seismic response coefficient R for the first floor special concrete shear walls and special reinforced masonry shear walls is 5.0. The seismic response coefficient R for the wood structural panel shear walls is 6.5. Section 12.2.3.1 of ASCE 7-10 requires the least value of R to be used for the building for the seismic design in that direction.

One approach that can be used for the seismic design would be to design the entire structure for the R value of 5.0. However, this would require the upper wood-frame portion of the structure to be designed for 30 percent higher forces in addition to inverting more of the building's mass (second floor) into the upper stories.

A more realistic approach (from both a seismic and economic perspective) would be to design the structure using the two-stage equivalent lateral force procedure prescribed in ASCE 7-10 §12.2.3.2. This procedure can be used where there is a flexible upper portion and a rigid lower portion. This structure type (flexible over rigid) is the structural opposite of the "soft story" structures that are not desirable.

The allowance of two-stage equivalent lateral force procedure for a flexible upper portion above a rigid lower portion has been in the building code since the *1988 Uniform Building Code* with essentially the same variables. This procedure is permitted in ASCE 7-10 §12.2.3.2 when the structure complies with the following criteria:

- A. The stiffness of the lower portion must be at least 10 times the upper portion.
- B. The period of the entire structure shall not be greater than 1.1 times the period of the upper portion.
- C. The flexible upper portion shall be designed as a separate structure using the equivalent lateral force or model response procedure and the appropriate values of R and ρ .
- D. The rigid lower portion shall be designed as a separate structure using the equivalent lateral force procedure and the appropriate values of R and ρ of the lower structure with the reactions from the upper structure scaled as described in ASCE 7-10.

For the purpose of this design example, the upper flexible structure and lower rigid structure are each regular and qualify for the equivalent lateral force procedure to be used.

4a. Stiffness Determinations

Stiffness of the lower portion must be at least 10 times the upper portion.

Wall rigidity (stiffness):

$$F = k\delta$$

Or

$$k = \frac{F}{\delta}$$

Where:

F = the applied force to the wall

k = the stiffness of the wall

δ = deflection of the wall



STIFFNESS OF FLEXIBLE UPPER PORTION:

Determine stiffness of typical interior cross wall:

Table 3. Determine Stiffness of Typical Interior Wall

Level	F (k)	Deflection δ_{xe} (in)	$k = \frac{F}{\delta}$ (k/in)
Roof	12.989	0.38	34.18
6th Floor	24.300	0.49	49.59
5th Floor	32.890	0.42	78.31
4th Floor	38.617	0.45	85.82
3rd Floor	41.480	0.50	82.96

Where: F = the applied force to the wall as determined from Table 6

δ = the computed shear wall deflection from Table 17

STIFFNESS OF RIGID LOWER PORTION:

Determine stiffness of typical interior cross wall:

From 3-D finite element analysis of the rigid lower portion, the average deflection of the first floor transverse shear wall at design seismic loading:

$$\delta_{walls} = 0.02 \text{ in}$$

$$F_{wall} = 190 \text{ kips}$$

$$k = \frac{190 \text{ k}}{0.02 \text{ in}} = 9,500 \frac{\text{k}}{\text{in}}$$

Ratio of rigid lower portion stiffness to flexible upper portion stiffness:

$$\text{ratio} = \frac{9,500}{82.96} = 114 > 10 \Rightarrow \text{Okay}$$

4b. Period Determinations

Check for conformance to the requirement that the period of the entire structure must not be greater than 1.1 times the period of the upper portion.

First determine building periods (see Figure 6 for section through structure) using the approximate fundamental period equations of ASCE 7-10 as opposed to computer model calculations.

For the flexible upper portion:

$$T_a = C_t(h_n)^x = 0.020(50.0)^{3/4} = 0.38 \text{ sec}$$

ASCE 7-10 Eq. 12.8-7

For the entire structure:

$$T_a = C_t(h_n)^x = 0.020(62.0)^{3/4} = 0.44 \text{ sec}$$

ASCE 7-10 Eq. 12.8-7

Ratio of periods:

$$\frac{0.44}{0.38} = 1.16 \approx 1.1 \Rightarrow \text{Criteria not met}$$

Using the ASCE 7-10 equation can produce period ratios > 1.1. This equation is problematic since the same coefficients are used for both wood and concrete shear walls to approximate the building periods.

ALTERNATE METHOD OF PERIOD DETERMINATION:

$$T = 2\pi \sqrt{\left(\sum_{i=1}^n w_i \delta_i^2\right) \div \left(g \sum_{i=1}^n f_i \delta_i\right)}$$

FEMA 450 Eq. C5.2-1

The above equation, which produces a more accurate building period, is based on Rayleigh’s method and was the equation that appeared in the *Uniform Building Code* (Eq. 30-10 in the 1997 UBC).

Table 4. Determine Period of Flexible Upper Portion

Level	w (k)	f (k)	Cumulative δ (in)	w(δ) ²	f(δ)
Roof	587	184.5	2.24	2,945.3	413.3
6th Floor	639	160.6	1.86	2,210.7	298.7
5th Floor	647	122.0	1.37	1,214.4	167.1
4th Floor	647	81.3	0.95	583.9	77.2
3rd Floor	647	40.7	0.50	161.8	20.4
Σ	3,167.00	589.1		7,116.0	976.7

$$T = 2\pi \sqrt{\frac{7,116.0}{(32.2 \times 12) 976.7}} = 0.863 \text{ sec}$$

Table 4A. Determine Period of Entire Structure

Level	w (k)	f (k)	Cumulative δ (in)	w(δ) ²	f(δ)
Roof	587	184.5	2.26	2,998.2	417.0
6th Floor	639	160.6	1.88	2,258.5	301.9
5th Floor	647	122.0	1.39	1,250.1	169.6
4th Floor	647	81.3	0.97	608.8	78.9
3rd Floor	647	40.7	0.52	174.9	21.2
2nd Floor	2,632	489.5	0.02	1.1	9.8
Σ	5,799	1,078.6		7,291.5	998.3

$$T = 2\pi \sqrt{\frac{7,291.5}{(32.2 \times 12) 998.3}} = 0.864 \text{ sec}$$

Ratio of periods:

$$\frac{0.864}{0.863} = 1.001 < 1.1 \Rightarrow \text{Okay}$$



4c. Design of Flexible Upper Portion

Design coefficients for the seismic force-resisting system (SFRS) from ASCE 7-10 Table 12.2-1 are as follows:

Type A-13: Light-framed walls with wood sheathing

$$R = 6.5$$

$$\Omega_0 = 3.0$$

$$C_d = 4.0$$

Maximum building height:

No height limit for seismic design categories B & C

65 feet for seismic design categories D, E & F

The flexible upper portion will be designed using the seismic response coefficient $R = 6.5$ and the redundancy factor ρ for that portion.

4d. Design of Rigid Lower Portion

Design coefficients for the SFRS:

Usually A1/A7:

For special reinforced concrete shear walls

$$R = 5.0$$

$$\Omega_0 = 2.5$$

$$C_d = 5.0$$

For special reinforced masonry shear walls

$$R = 5.0$$

$$\Omega_0 = 2.5$$


$$C_d = 3.5$$

The rigid lower portion will be designed using the seismic response coefficient $R = 5.0$ and the redundancy factor ρ for that portion.

5. Seismic Design of Flexible Upper Portion and Rigid Lower Portion

5a. Seismic Design of Flexible Upper Portion

Figure 6. Typical Cross-Section through Building

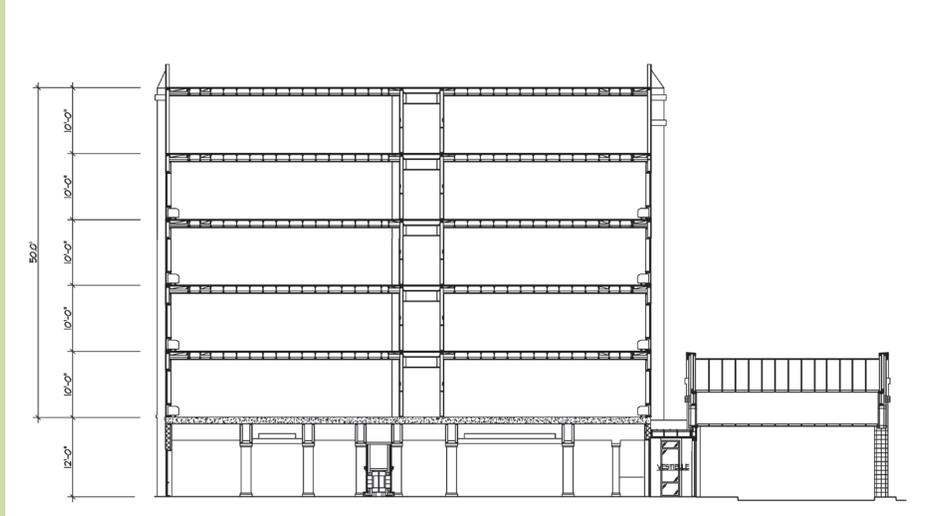

SEISMIC AND SITE DATA:

Seismic Design Category D

For building frame systems with light-frame walls sheathed with wood structural panels

$R = 6.5$

ASCE 7-10 Table 12.2-1

Redundancy factor $\rho = 1.0$

ASCE 7-10 §12.3.4.2

(See §5d)

DESIGN BASE SHEAR:

Design checklist:

1. Determine Risk Category and Importance Factor
2. Determine S_S , S_1 and soil profile from site location
3. Test for SDC E
4. Determine S_{D5} and S_{D1}
5. Determine T and test for short period exception on SDC
Determine if equivalent lateral force analysis is allowed
6. Determine SDC (if not E)
7. Determine R and verify height
8. Test for $S_S < 1.5$ and calculate C_S base shear
9. Determine C_S



Determine Risk Category and Importance Factor:

Risk Category: II

ASCE 7-10 T1.5-2

Importance Factor $I = 1.0$

Determine S_s , S_1 and soil profile:

Site Class D (based upon geotechnical investigation)

Without a geotechnical investigation, Site Class D needs to be used as the default value.

Therefore, from U.S. Geological Survey (USGS) application:

$$S_s = 1.808g \gg 0.15$$

Therefore, not SDC A

$$S_1 = 0.692g \gg 0.04$$

Therefore, not SDC A

$$S_1 = 0.692g < 0.75$$

Therefore, not SDC E

$$S_1 = 0.692g > 0.6$$

Therefore, EQ. 12.8-6 applies

Values for S_s and S_1 can be determined from ASCE 7-10 maps or from the USGS website, which provides the values by either zip code or longitude and latitude coordinates. It is recommended that the longitude and latitude coordinates (which can be obtained from the street address) be used.

USGS website link: <http://earthquake.usgs.gov/designmaps/us/application.php>

Download the JAVA Ground Motion Parameter Calculator and enter the latitude and longitude.

Note: Using Zip Code S_s is overstated 3 percent

Test for SDC E:

From Tables 11.4-1 and 11.4-2 select $F_a = 1.0$ and $F_v = 1.5$

Therefore from Table 1613.3.5-1 and -2:

$$S_{DS} = \frac{2}{3} S_{MS} = \frac{2}{3} F_a S_s = \left(\frac{2}{3}\right) 1.0 \times 1.808 = 1.206 > 0.5$$

Implies SDC D

$$S_{D1} = \frac{2}{3} S_{M1} = \frac{2}{3} F_v S_1 = \left(\frac{2}{3}\right) 1.5 \times 0.692 = 0.692 > 0.2$$

Implies SDC D

Determine period and test for short period exception on SDC:

Period using approximate fundamental period (see Figure 6 for section through structure)

$$T_a = C_t(h_n)^x 0.020(62)^{\frac{3}{4}} = 0.44 \text{ sec} \quad \text{ASCE 7-10 Eq 12.8-7}$$

where h_n is defined as the highest level of the structure. Since the highest level is not a level surface, the center of gravity (average height) of the diaphragm above the first floor will be used.

$$T_s = \frac{S_{D1}}{S_{D5}} = \frac{0.692}{1.206} = 0.57 \text{ sec}$$

$$80\% T_s = 0.46 > T_a = 0.44 \text{ sec}$$

Therefore, the exception applies but doesn't matter since SDC D occurs on both short and long period.

Therefore SDC = D

Check for permitted analytical procedure:

ASCE 7-10 T12.6-1

Since $T_a < 3.5 T_s$ and the structure is light-frame construction, equivalent lateral force analysis procedure is permitted.

Determine SDC:

Based upon above checks, SDC = D

Determine R and verify height:

For light-framed walls with wood structural panels that are both shear walls and bearing walls:

ASCE 7-10 T12.2-1

$$R = 6.5$$

Maximum height permitted in SDC D is 65 feet

ASCE 7-10 T12.2-1

Our building structure is less than 65 feet and is therefore permitted.

Test for $S_s < 1.5$:

Note: The building in this design example has a "Type II" weight (mass) irregularity between the second and third floors, which is a vertical irregularity. It is not clear whether a building that is designed using the two-stage analysis (ASCE 7-10 §12.2.3.2) should be exempted from this provision. Since each structure can be treated separately, it seems reasonable to conclude that the weight mass irregularity does not apply in the two-stage design approach. In addition, it is not clear whether the number of stories being limited to five or less applies to a two-stage podium slab type of design. For actual projects, building officials in the local jurisdiction should be contacted for their interpretation of the code.



Determine C_s :

$$C_s = \frac{S_{DS}}{\left(\frac{R}{I}\right)}$$

$$C_s = \frac{1.206}{\left(\frac{6.5}{1.0}\right)} = 0.186$$

but need not exceed

$$C_s = \frac{S_{D1}}{T \left(\frac{R}{I}\right)}$$

ASCE 7-10 Eq 12.8-3

$$C_s = \frac{0.692}{.044 \left(\frac{6.5}{1.0}\right)} = 0.242 > 0.186$$

therefore does not control but shall not be less than

$$C_s = 0.01$$

therefore does not control

In addition, equation 12.8-6 requires an additional check for C_s , minimum for structures that are located where S_1 is equal to or greater than 0.6g:

$$C_s = \frac{0.5 S_1}{\left(\frac{R}{I}\right)} = \frac{0.5(0.692)}{\left(\frac{6.5}{1.0}\right)} = 0.05$$

therefore does not control

$$C_s = 0.186$$

Therefore:

$$V = C_s W = 0.186W$$

For the flexible upper portion:

$$W = 3,167 \text{ k}$$

$$V = C_s W = 0.186 \times 3,167 = 589 \text{ k}$$

For the building as a whole using the same $R = 6.5$:

$$W = 5,799 \text{ k}$$

$$V = C_s W = 0.186 \times 5,799 = 1,079 \text{ k}$$

VERTICAL DISTRIBUTION OF FORCES

ASCE 7-10 §12.8.3

The biggest advantage of using a two-stage design is that the base for the upper flexible portion is set on top of the podium slab. The heavy mass of the podium slab (second floor) is not inverted into the upper flexible portion of the structure. Hence, the base shear is based on the weight (W) of the structure that is above the podium slab.

The base shear must be distributed to each level. This is done as follows:

$$F_x = C_{vx}V$$

ASCE 7-10 Eq.12.8-11

$$C_{vx} = \frac{w_x h_x}{\sum_{i=1}^n w_i h_i^k}$$

ASCE 7-10 Eq.12.8-12

Where h_x is the average height at level i of the sheathed diaphragm in feet above the base, k is a distribution exponent related to the building period.

Since $T = 0.38$ second < 0.5 seconds, $k = 1$

Determination of F_x is shown in Table 5.

ASCE 7-10 §12.8.3

Note that the vertical distribution of seismic forces using the base of the structure at the first floor (Table 5A) produces overly conservative results due to the tall first floor of 22 feet. For illustrative purposes, the vertical distribution of seismic forces including the second floor (without the two-stage analysis) and using the R coefficient of 6.5 for the wood sheathed walls is included in Table 5B. However, this design example uses the vertical distribution of seismic forces using the base of the structure at the second floor (Table 5) using the two-stage analysis.

Table 5. Vertical Distribution of Seismic Forces (with Base at Second Floor)

Level	w_x (k)	h_x (ft)	$w_x h_x$ (k-ft)	$\frac{w_x h_x}{\sum w_i h_i}$ (%)	F_x (k)	$\frac{F_x}{w_x}$	F_{tot} (k)	$\frac{F_x}{A}$ (psf)
Roof	587	50	29,350	31.3	184.5	0.314	184.5	15.37
6th Floor	639	40	25,560	27.3	160.6	0.251	345.1	13.39
5th Floor	647	30	19,410	20.7	122.0	0.189	467.1	10.17
4th Floor	647	20	12,940	13.8	81.3	0.126	548.4	6.78
3rd Floor	647	10	6,470	6.9	40.7	0.063	589.1	3.39
Σ	3,167		93,730	100.0	589.1		589.1	

Where: A = area of the floor plate which is 12,000 ft²



Table 5A. Vertical Distribution of Seismic Forces (with Base at First Floor) not including Second Floor in Distribution

Not used in this design example – for illustrative purposes only

Level	w_x (k)	h_x (ft)	$w_x h_x$ (k-ft)	$\frac{w_x h_x}{\sum w_i h_i}$ (%)	F_x (k)	$\frac{F_x}{w_x}$	F_{tot} (k)	$\frac{F_x}{A}$ (psf)
Roof	587	62	36,394	27.6	162.7	0.277	162.7	13.56
6th Floor	639	52	33,228	25.2	148.6	0.233	311.3	12.38
5th Floor	647	42	27,174	20.6	121.5	0.188	432.8	10.13
4th Floor	647	32	20,704	15.7	92.6	0.143	525.4	7.72
3rd Floor	647	22	14,234	10.8	63.6	0.098	589.1	5.30
Σ	3,167		131,734	100.0	589.1		589.1	

Table 5B. Vertical Distribution of Seismic Forces (with Base at First Floor) including Second Floor in Distribution

Not used in this design example – for illustrative purposes only

Level	w_x (k)	h_x (ft)	$w_x h_x$ (k-ft)	$\frac{w_x h_x}{\sum w_i h_i}$ (%)	F_x (k)	$\frac{F_x}{w_x}$	F_{tot} (k)	$\frac{F_x}{A}$ (psf)
Roof	587	62	36,394	22.3	240.4	0.409	240.4	20.03
6th Floor	639	52	33,228	20.3	219.5	0.343	459.8	18.29
5th Floor	647	42	27,174	16.6	179.5	0.277	639.3	14.96
4th Floor	647	32	20,704	12.7	136.7	0.211	776.0	11.39
3rd Floor	647	22	14,234	8.7	94.0	0.145	870.0	7.83
2nd Floor	2,632	12	31,584	19.3	208.6	0.079	1,078.6	17.38
Σ	5,799		163,318	100.0	1,078.6		1,078.6	

5b. Assumption of Flexible Diaphragms

ASCE 7-10 §12.3.1.1

For structures with wood-framed shear walls, ASCE 7-10 §12.3.1.1 allows wood diaphragms to be idealized as flexible diaphragms when one of the following conditions exist:

1. The structure is a one- or two-family dwelling.
2. Toppings of concrete are nonstructural and are a maximum of 1-1/2 inches thick.
3. Each line of vertical elements of the lateral force-resisting system complies with the allowable story drift.

In this design example, the second condition is met since our structure does not exceed 1-1/2 inches of lightweight concrete.

Condition 3 is met since §8c of this design example for drift check of typical shear wall complies with the allowable story drift.

5c. Flexible vs. Rigid Diaphragm Analysis

ASCE 7-10 §12.3.1 requires that, unless a diaphragm can be idealized as flexible, calculated as flexible or idealized as rigid, it be modeled as semi-rigid. The diaphragms in most wood structures can be idealized as flexible. However, in some cases, engineering judgment must be used to determine shear distributions to the shear walls. With the uniformity of shear wall lengths and spacing in the building's transverse direction (north-south), flexible diaphragm assumptions are certainly justifiable from a code compliance perspective.

Current industry standard is to consider rigidities of the shear walls in determining the horizontal distribution of lateral forces, either from a rigid diaphragm assumption or an envelope method applying the highest load from a flexible diaphragm assumption and rigid diaphragm assumption to each shear wall. Some engineers designing structures similar to this design example will place shear walls at interior corridor walls (see Figure 3) and not place any lateral-resisting elements at the exterior walls. This approach, as a minimum, must utilize a semi-rigid or rigid diaphragm design. In such configurations careful consideration of the deflections of horizontal diaphragms and the effect of the deflections on building performance is recommended. SDPWS 2015 has added direction that the diaphragm deflection calculations include diaphragm shear and bending deformations and the story drift at the edge of the structure not exceed the ASCE 7 allowable story drift for seismic loads.

Engineers now have sophisticated design software available for designing structures of this type. With all that is available, many engineers still analyze "individual units." Some engineers perform a rigid diaphragm analysis and a few perform envelope solutions. These varying designs all get permitted by local building officials and there is not a lot of continuity in the design process even within cities. For this design example, an "envelope" design was utilized.



5d. Flexible Upper Portion Redundancy Factor

The redundancy factor (ρ) for the flexible upper portion is 1.0. Both conditions of ASCE 7-10 §12.3.4.2 have been met, though designers are only required to meet one of the two provisions.

5e. Seismic Design of Rigid Lower Portion

Since the center of mass of the flexible upper structure coincides with the center of mass of the rigid lower portion, the entire structure mass can be joined together and applied at the center of the podium's rigid diaphragm with the code-required eccentricities.

Whenever the R (and ρ) value differs between the upper wood structure and lower podium structure, as would be the case with a light-frame wood shear wall system ($R = 6.5$) over a special concrete shear wall system ($R = 5$), then scaling of the seismic reactions at the bottom of the upper structure to apply to the lower structure is required. The seismic forces (e.g., shear and overturning) at the base of the upper portion are applied to the top of the lower portion and scaled up by the ratio of $(R/\rho)_{\text{upper}}$ to $(R/\rho)_{\text{lower}}$. The scaling of gravity loads from the upper portion is not done in the same manner when applied to the lower portion. The lower portion, which now includes the seismic forces from the upper portion, may then be analyzed using the values of R , ρ , and C_d for the lower portion of the structure.

6. Shear Wall Design Example

This design example features a five-story "segmented shear wall" with an out-to-out length of 29.0 feet and floor-to-floor heights of 10.0 feet. SDPWS-2008 §4.3.5.1 categorizes this wall type as having full-height wall segments with aspect ratio limitations of SDPWS-2008 §4.3.4 applying to each full height segment.

CHECK H/W RATIO FOR SHEAR WALL SEGMENTS:

Segment height = 10.0 ft

Segment width = 29.0 ft

$$h/w = \frac{10.0}{29.0} = 0.34 < 2.0 \Rightarrow \text{Okay}$$

6a. Determination of Lateral Loads to Shear Wall

ASCE 7-10 12.3.1.1

The structure used in this design example has interior shear walls located at every other wall between hotel guest units. The walls are spaced at 13 feet o.c., with the depth of the building equal to 65 feet.

Based on an "envelope" design using flexible diaphragm assumptions and a rigid diaphragm analysis, the critical forces to the interior shear wall (Figure 7) are shown in Table 6.

Figure 7. Typical Interior Shear Wall Elevation

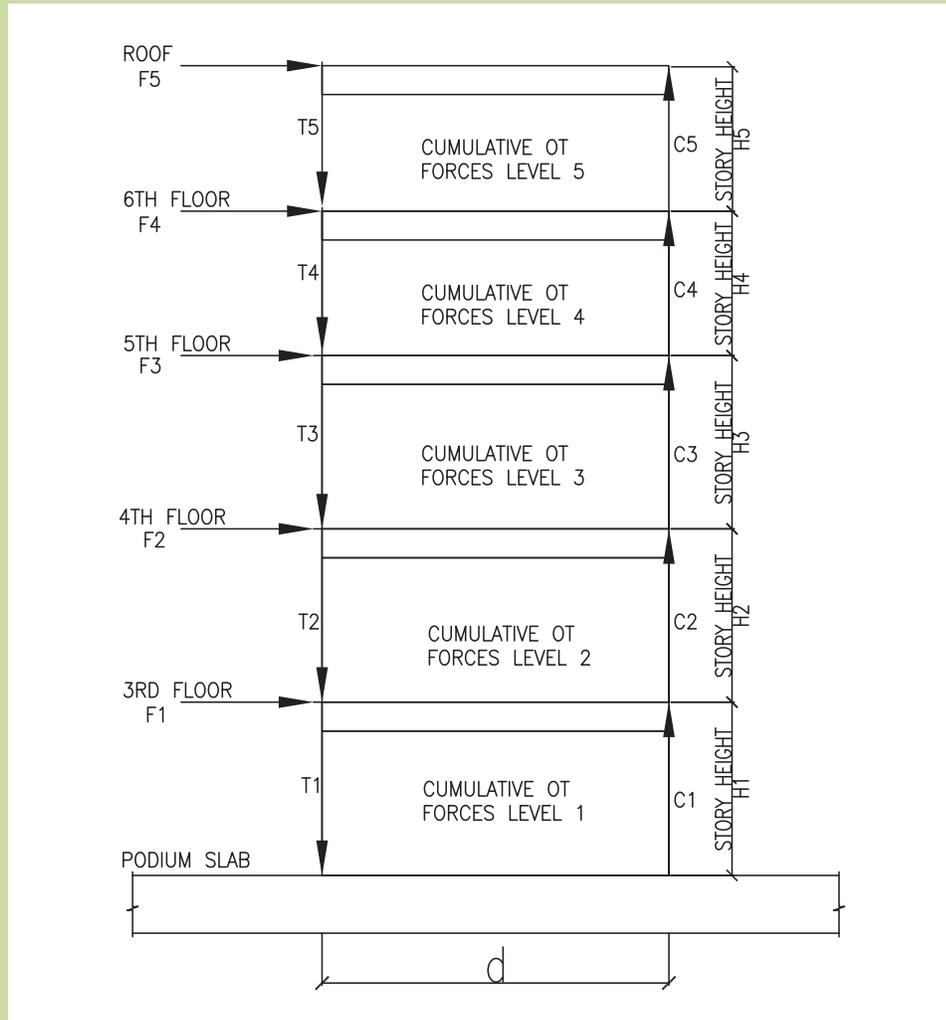


Table 6. Distribution of Seismic Forces for Both Shear Walls

Level	Designation	F_{Total} (lb)
Roof	F_5	12,989
6th Floor	F_4	24,300
5th Floor	F_3	32,890
4th Floor	F_2	38,617
3rd Floor	F_1	41,480



6b. Determination of Shear Wall Sheathing and Nailing

The shear wall to be designed will use $1\frac{5}{32}$ -inch Structural I rated sheathing using 10d common nails with a minimum penetration of 1- $\frac{1}{2}$ inches into the framing members.

A 2x4 sole plate (sill plate) will be used at the base of the shear wall.

SDPWS-2008 §4.3.7.1, item 4c, states that:

3x nominal framing at abutting panel edges is required when the required nominal shear capacity exceeds 700 plf in Seismic Design Category (SDC) D, E or F. If panels do not abut at a sill or sole plate, 2x material is acceptable for shear wall capacities exceeding this threshold.

Table 7. Determination of Shear Wall Nailing

Designation	F _{Total} (lb)	Wall Length <i>ℓ</i> (ft)	ASD Design			
			$V = \frac{F_{Total}(0.7)}{\ell}$ (plf)	Wall Sheathed 1 or 2 sides	Allowable Shear ^a (plf)	Fastener Edge Spacing ^b
F ₅	12,989	29.0	314	1	340	6
F ₄	24,300	29.0	587	1	870	2 ^c
F ₃	32,890	29.0	794	2	1,740	2 ^c
F ₂	38,617	29.0	932	2	1,740	2 ^c
F ₁	41,480	29.0	1,001	2	1,740	2 ^c

Notes for Table 7:

- Allowable shear values are obtained by taking the nominal unit shear capacities in NDS-08 SDPWS-2008 Table 4.3A and dividing by the ASD reduction factor of 2.0.
- A 2x4 sole plate (sill plate) will be used at the base of walls (see Figure 5). For 10d common nails spaced at 2 inches o.c., the nails are staggered. From a constructability standpoint (framer bent over to install nails) and for improved structural performance (larger edge distance), the use of a 3x sole plate is recommended.
- Where fastener spacing is 2 inches o.c., some engineers may use sheathing on both sides of the wall with fasteners spaced at 4 inches o.c. for better performance and less drift.

6c. Shear Wall Cumulative Overturning Forces

When designing overturning forces in multi-level structures, shear and the respective overturning forces due to seismic (or wind) must be carried down to the foundation, or in this design example the podium slab, by the boundary studs and continuous tie-down system. These forces are cumulative over the height of the building, and shear forces applied at the upper levels will generate much larger base overturning moments than if the same shear forces were applied at the lower story.

The overturning forces for the shear wall (Figure 7) can be obtained by summing forces about the base of the wall for the level being designed.

Cumulative overturning force for the sixth floor level:

$$M_{ot} = F_5 (H_5)$$

Cumulative overturning force for the fifth floor level:

$$M_{ot} = F_5 (H_5 + H_4) + F_4(H_4)$$

Cumulative overturning force for the fourth floor level:

$$M_{ot} = F_5 (H_5 + H_4 + H_3) + F_4 (H_4 + H_3) + F_3(H_3)$$

Cumulative overturning force for the third floor level:

$$M_{ot} = F_5 (H_5 + H_4 + H_3 + H_2) + F_4 (H_4 + H_3 + H_2) + F_3 (H_3 + H_2) + F_2(H_2)$$

Cumulative overturning force for the second floor level:

$$M_{ot} = F_5 (H_5 + H_4 + H_3 + H_2 + H_1) + F_4 (H_4 + H_3 + H_2 + H_1) + F_3 (H_3 + H_2 + H_1) + F_2 (H_2 + H_1) + F_1 (H_1)$$

In shear walls with continuous tie-down systems, the overturning resistance in the shear wall is resisted by the posts and/or end studs resisting the compression forces and the tension rods resisting the tension forces.

In shear walls with conventional holdown systems, the overturning resistance in the shear wall is resisted by the posts and/or end studs resisting the compression forces and the tension forces.

6d. Load Combinations using 2012 IBC

IBC §1605.3.2 has alternative basic load combinations to ASCE 7-10. For allowable stress design, the earthquake load combinations are:

$$D + L + S + \frac{E}{1.4} \quad \text{IBC Eq.16-21}$$

Since S is not present, the simplified load combination is:

$$D + L + \frac{E}{1.4}$$

Where E = the horizontal seismic force (F):

$$0.9D + \frac{E}{1.4} \quad \text{IBC Eq.16-22}$$

6e. Load Combinations using ASCE 7-10

§12.4.2.3

Per §12.4.2.3, the following load combinations shall be used for basic combinations for allowable stress design:

$$(1.0 + 0.14 S_{DS})D + 0.7\rho Q_E \quad \text{ASCE 7-10 Eq. 5}$$

$$(1.0 + 0.10 S_{DS})D + 0.525\rho Q_E + 0.75L + 0.75 S \quad \text{ASCE 7-10 Eq. 6b}$$

$$(0.6 - 0.14 S_{DS})D + 0.7\rho Q_E \quad \text{ASCE 7-10 Eq. 8}$$

Where the dead load D is increased (or decreased) for vertical accelerations by the S_{DS} coefficient.



Where Q_E = the horizontal seismic force F

ASCE 7-10 §12.4.2.1

$$0.10 S_{DS} = 0.10 (1.206) = 0.12$$

$$0.14 S_{DS} = 0.14 (1.206) = 0.17$$

6f. Shear Wall Chord (Boundary) Members

The vertical members at the end of the shear walls are the walls' chords (boundary members). As in a diaphragm, the chords resist flexure and the sheathing (web) resists the shear. The overturning moment is resolved into a T-C couple creating axial tension and compression forces. When considering only the horizontal component of the seismic forces, the tension and compression forces are equal and opposite. The overturning compressive force is determined by dividing the overturning moment by the distance "d" between the center of the tension rod and the center of the compression posts (Figure 9). However, in most designs, the size and number of chords (boundary members) change from story to story as shown in Figures 10 and 11, which can necessitate iterations to derive the actual distance "d." Many engineers will take a "conservative average" distance "d" and use the same value for all cases to minimize iterations.

Figure 9 illustrates multiple boundary members that are common to multi-level wood-frame shear walls.

The axial loads to the bearing wall and boundary members are determined from the following loads:

DEAD LOADS:

$$W_{\text{Roof}} = (28.0 \text{ psf})(2.0 \text{ ft}) = 56.0 \text{ plf}$$

$$W_{\text{Floor}} = (30.0 \text{ psf})(13.0 \text{ ft}) = 390 \text{ plf}$$

$$W_{\text{Wall}} = (10.0 \text{ psf})(10.0 \text{ ft}) = 100.0 \text{ plf}$$

LIVE LOADS:

$$W_{\text{Roof}} = (20.0 \text{ psf})(2.0 \text{ ft}) = 40.0 \text{ plf}$$

$$W_{\text{Floor}} = (40.0 \text{ psf})(13.0 \text{ ft}) = 520 \text{ plf}$$

DEAD + LIVE LOADS:

$$W_{\text{Roof}} = (28.0 \text{ psf} + 20.0 \text{ psf})(2.0 \text{ ft}) = 96.0 \text{ plf}$$

$$W_{\text{Floor}} = (30.0 \text{ psf} + 40.0 \text{ psf})(13.0 \text{ ft}) = 910 \text{ plf}$$

$$W_{\text{Wall}} = 10.0 \text{ psf} (10.0 \text{ ft}) = 100.0 \text{ plf}$$

(1.2 + 0.2 S_{DS}) DEAD + LIVE LOADS:

Per §12.4.2.3 of ASCE 7-10, the load factor on L is permitted to be 0.5 since the live load is equal to or less than 100 psf and not of public assembly. The 0.5 factor will be used in the live load determinations below:

$$W_{\text{Roof}} = ((1.4 \times 28.0 \text{ psf}) + (0.5 \times 20.0 \text{ psf}))(2.0 \text{ ft}) = 98.5 \text{ plf}$$

$$W_{\text{Floor}} = ((1.4 \times 30.0 \text{ psf}) + (0.5 \times 40.0 \text{ psf}))(13.0 \text{ ft}) = 806 \text{ plf}$$

$$W_{\text{Wall}} = 1.4 \times 10.0 \text{ psf}(10.0 \text{ ft}) = 140.0 \text{ plf}$$

Figure 8. Shear Wall Elevation with Distance D


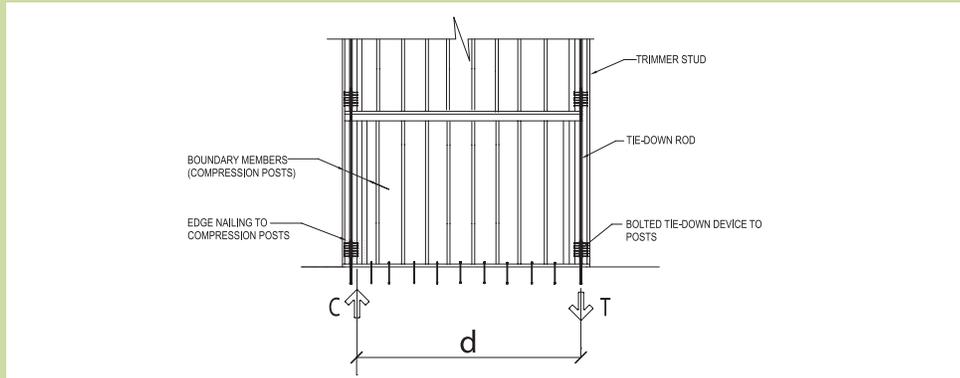


Figure 9. Example Elevation of Shear Wall Boundary Members

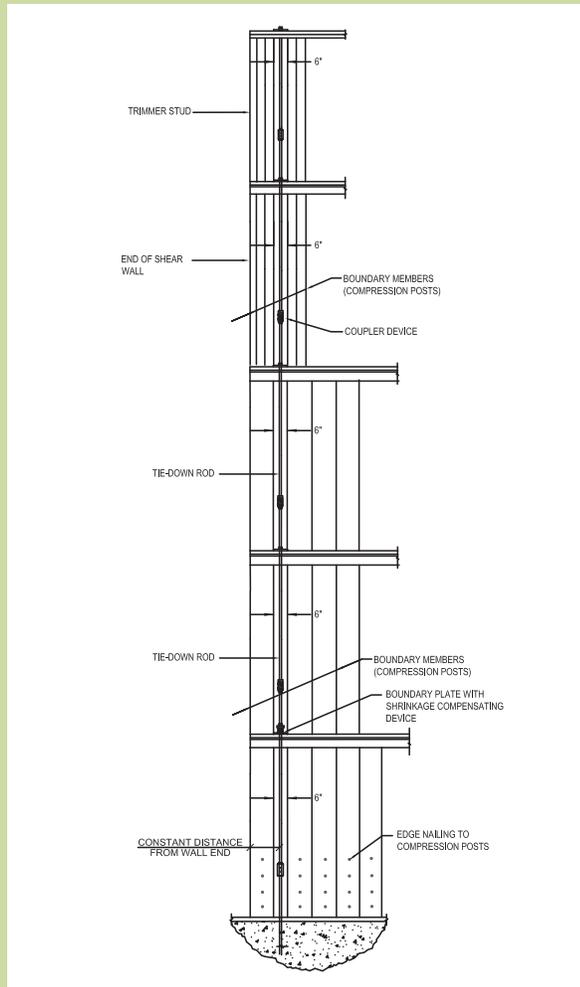


Notes for Figures 9 AND 10:

1. Some continuous rod systems favor centering the rod so it is supported symmetrically by compression elements (concentric with the tension rod), while other continuous rod systems favor an asymmetrical orientation of compression elements (shown in Figures 9 and 10).
2. See Figures 13, 14 and 15 for comments on blocking at the floor framing.



Figure 10. Example Plan Section at Boundary Members

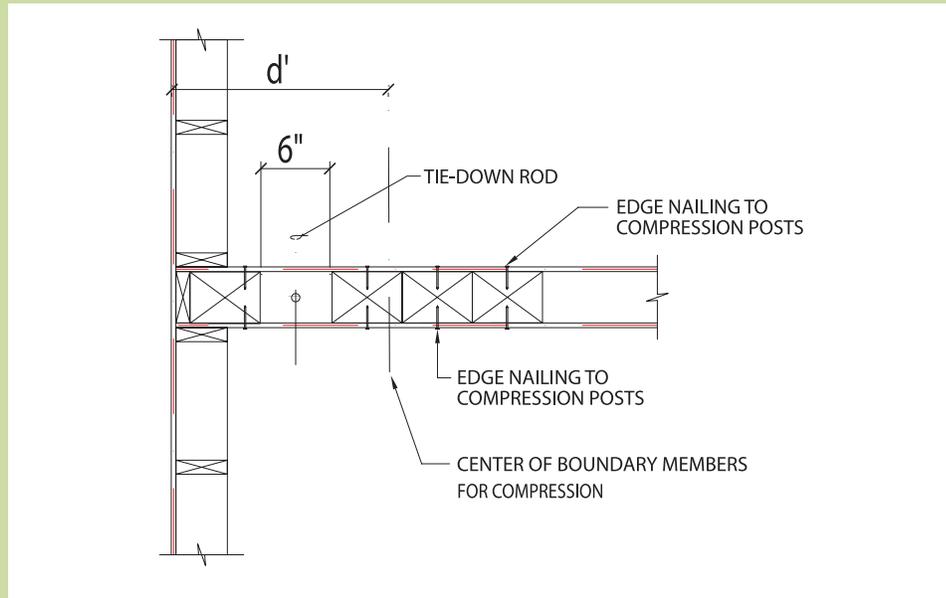

For ASD compression on the chord members, the alternate basic load combination is used.

$$D + L + \frac{E}{1.4}$$

IBC Eq. 16-21

For strength compression on the chord members, the ASCE 7-10 seismic load combination will be used. The strength compression loads are used later in this example to determine the shear wall deflection at strength loads (sill plate crushing). Per ASCE 7-10 §12.8.6 and §12.12.1, strength level forces are required for the determination of shear wall deflections.

$$(1.2 + 0.2S_{DS})D + \rho Q_E + L + 0.2S$$

Where:

$$\rho Q_E = E$$

Since S is not present, the simplified load combination is:

$$(1.2 + 0.2S_{DS})D + L + E$$

Where:

$$(1.2 + 0.2S_{DS}) = (1.2 + 0.2 \times 1.206) = 1.4$$

ASCE 7-10 §12.4.2.3

$$E = \frac{M_{OT}}{d}$$

Table 8. Determination of Shear Wall Chord Member Forces

Level	M _{OT} (ft-k)	ASD P _{D+L} (k)	d' (ft)	d (ft)	ASD Demand Compression	Strength Demand Compression
					$C = \frac{M_{OT}}{1.4d} + P_{D+L}$ (k)	$\frac{M_{OT}}{d} + (1.2 + 0.2S_{DS})D + L$ (k)
Roof	129.89	0.380	0.98	27.04	3.81	5.27
6th Floor	372.89	2.36	0.98	27.04	12.21	16.11
5th Floor	701.79	7.00	1.71	26.31	26.05	33.40
4th Floor	1,087.95	10.19	1.71	26.31	39.72	51.07
3rd Floor	1,502.75	13.39	2.04	25.98	54.69	70.54

Where: $P_{D+L} = w(d')^2$

FOR ASD DEMAND (see §6f):

$P_{D+L \text{ Roof}} = (96 \text{ plf} + 100 \text{ plf})(0.98 \times 2) = 0.384 \text{ k}$
 $P_{D+L \text{ 6thFloor}} = (910 \text{ plf} + 100 \text{ plf})(0.98 \times 2) + P_{\text{Roof}} = 2.36 \text{ k}$
 $P_{D+L \text{ 5thFloor}} = ((910 \text{ plf} + 100 \text{ plf})^2 + (96 + 100))(1.58 \times 2) = 7.00 \text{ k}$
 $P_{D+L \text{ 4thFloor}} = ((910 \text{ plf} + 100 \text{ plf})^3 + (96 + 100))(1.58 \times 2) = 10.19 \text{ k}$
 $P_{D+L \text{ 3rdFloor}} = ((910 \text{ plf} + 100 \text{ plf})^4 + (96 + 100))(1.58 \times 2) = 13.39 \text{ k}$

FOR STRENGTH DEMAND (see §6f):

$(1.2 + 0.02 S_{DS})D + L = 1.4D + L$
 $P_{D+L \text{ Roof}} = (98.5 \text{ plf} + 140 \text{ plf})(0.98 \times 2) = 0.467 \text{ k}$
 $P_{D+L \text{ 6thFloor}} = (806 \text{ plf} + 140 \text{ plf})(0.98 \times 2) + P_{\text{Roof}} = 2.32 \text{ k}$
 $P_{D+L \text{ 5thFloor}} = ((806 \text{ plf} + 140 \text{ plf})^2 + (98.5 + 140))(1.58 \times 2) = 6.73 \text{ k}$
 $P_{D+L \text{ 4thFloor}} = ((806 \text{ plf} + 140 \text{ plf})^3 + (98.5 + 140))(1.58 \times 2) = 9.72 \text{ k}$
 $P_{D+L \text{ 3rdFloor}} = ((806 \text{ plf} + 140 \text{ plf})^4 + (98.5 + 140))(1.58 \times 2) = 12.71 \text{ k}$

Table 9. Determination of Shear Wall Chord Members

Level	Chord Posts	Total Area	l_e (ft)	C_f	C_p	Bearing Cap. (kips)	ASD Demand (kips)	Stability Capacity (kips)	D/C Ratio
Roof	4-3x4	35.0	9.625	1.15	0.163	21.88	3.81	15.75	0.24
6th Floor	4-3x4	35.0	9.625	1.15	0.163	21.88	12.21	15.75	0.78
5th Floor	4-4x8	101.5	9.625	1.05	0.182	63.44	26.05	46.48	0.56
4th Floor	4-4x8	101.5	9.625	1.05	0.182	63.44	39.72	46.48	0.85
3rd Floor	5-4x8	126.9	9.625	1.05	0.182	79.30	54.69	58.09	0.94



Notes for Table 9:

1. $C_d = 1.6$

2. Bearing capacity (on sole plate) = $F'_{c\perp} AC_b$

3. Column bearing factor $C_b = 1.0$

4. Column stability factor
$$C_p = \frac{1 + (F_{cE}/F_c^*)}{2c} - \sqrt{\left[\frac{1 + (F_{cE}/F_c^*)}{2c} \right]^2 - \frac{F_{cE}/F_c^*}{c}}$$

5. Column stability capacity = $F_c C_D C_F C_p A$

Example for four 4x8 posts: $4 \times 11.62 = 46.48$ kips

6. The typical interior stud wall is framed with 4-inch nominal framing studs.

7. Interior bearing walls for this design example are non-rated and, as such, would not require the reduction in allowable loads.

6g. Example Compression Member Capacity Determination

4X8 POST – DOUGLAS FIR-LARCH NO. 1:

Where:

$A = 25.375 \text{ in}^2$

$C_D = 1.6$

$E_{min} = 620,000 \text{ psi}$

$d_1 = 3.5 \text{ in}$

The following coefficients for C_m and C_t are not referenced in the NDS formulas (for simplicity).

$C_m = 1.0$

$C_t = 1.0$

$K_{e1} = 1.0$

The members' span between the top of the 2x4 sill plate and the underside of the 4x4 top plate (see Figure 4).

$l = 9.52 \text{ ft}$

$l_{e1} = 9.52 \times 12 = 114 \text{ in}$

$l_{e1}/d_1 = 114/3.5 = 32.64$

Slenderness is controlled by the minor axis and is thus used in the F_{cE} calculation.

Compression parallel to grain:

$F'_c = F_c C_D C_F C_p$

$F_c^* = F_c C_D C_F = 1,500 \times 1.6 \times 1.05 = 2,520 \text{ psi}$

$$C_p = \frac{1 + (F_{cE}/F_c^*)}{2c} - \sqrt{\left[\frac{1 + (F_{cE}/F_c^*)}{2c} \right]^2 - \frac{F_{cE}/F_c^*}{c}} = 0.1817$$

NDS Eq. 3.7-1

Where:

$$c = 0.8$$

$$F_{CE} = \frac{0.822E_{min}}{(\ell_e/d)^2} = \frac{0.822 \times 620,000}{32.64^2} = 478.4 \text{ psi}$$

NDS Eq. 3.7-1

$$F_{CE}/F_c^* = \frac{478.4}{2,520} = 0.1898$$

$$F'_c = F_c C_D C_F C_P = 1,500 \times 1.6 \times 1.05 \times 0.1817 = 458 \text{ psi}$$

FOR A 4X8 POST:

$$P_{allow} = A \times F'_c = 25.375 \times 458 = 11,620 \text{ lbs}$$

Compression perpendicular to grain:

$$F'_{c\perp} = 625 \text{ psi}$$

FOR A 4X8 POST:

$$P_{allow} = A \times F'_{c\perp} = 25.375 \times 625 = 15,860 \text{ lbs}$$

6h. Determine Resisting Moments and Uplift Forces

The resisting moment M_R is determined from the following dead loads:

$$W_{Roof} = 28.0 \text{ psf (2.0 ft)} = 56.0 \text{ plf}$$

$$W_{Floor} = 30.0 \text{ psf (13.0 ft)} = 390.0 \text{ plf}$$

$$W_{Wall} = 10.0 \text{ psf (10.0 ft)} = 100.0 \text{ plf}$$

Tables 10 and 10A illustrate the differences in ASD uplift values that can be calculated from using the ASCE 7-10 formula and the alternate IBC formula. For this design example, the ASCE 7-10 equation in Table 11 is used.

Table 10. Determine Shear Wall Uplift Forces using ASCE 7-10 Load Combinations

Level	M_R (ft-lb)	d (ft)	M_{OT} (ft-lb)	ASD Uplift ¹	ASD Differential Load Per Floor (lbs)	Strength Uplift ² (lbs)
				$\frac{(M_{OT} \times 0.7) - (0.6 - 0.14 S_{DS})M_R}{d}$ (lbs)		
Roof	65,598	27.04	129,887	2,319	0	3,205
6th Floor	271,643	27.04	372,889	5,333	3,014	7,172
5th Floor	477,688	26.31	701,789	10,864	5,530	14,713
4th Floor	683,733	26.31	1,087,954	17,770	6,906	24,213
3rd Floor	889,778	25.98	1,502,751	25,758	7,988	35,280

¹Where $(0.6 - 0.14 S_{DS}) = (0.6 - 0.14 \times 1.206) = 0.43$

²Strength uplift forces will be used for determining strength rod elongations. Strength uplift force = $(M_{OT} - (0.9 - 0.2S_{DS})M_R)/d$



Table 10A. Determine Shear Wall Uplift Forces using IBC Alternate Load Combinations

Level	M _R (ft-lb)	d (ft)	Strength	ASD Uplift	Differential Load Per Floor (lbs)
			M _{OT} (ft-lb)	$\left(\frac{M_{OT}}{1.4} \right) - 0.9 M_R$ d (lbs)	
Roof	65,598	27.04	129,887	1,248	0
6th Floor	271,643	27.04	372,889	809	-439
5th Floor	477,688	26.31	701,789	2,712	1,903
4th Floor	683,733	26.31	1,087,954	6,147	3,435
3rd Floor	889,778	25.98	1,502,751	10,491	4,343

Note for Table 10A:

A "negative" differential load is a result of a higher resisting moment and occurs at a lower level than above.

6i. Shear Wall Tie-Down System Components

TIE-DOWN RODS

Smaller diameter tie-down rods are usually made from A36/A307 steel. This is called standard rod strength. Unless marked, rods should be considered standard rod strength. High-strength rods are A449 or A193-B7 and are usually marked on the end with an embossed stamp, though some rod manufacturers stamp the rod grade on the side. If the rod is stamped at the end and is cut, it needs to be re-marked. High-strength rods should have special inspection to confirm the rod type since the ends of these rods may be embedded into a coupler where the marks cannot be seen after installation. It should be noted that high-strength rods are not weldable. Proprietary systems have special rod colors and markings on the sides. The rods and tie-down systems are not proprietary, but the manufactured components are.

TIE-DOWN ELONGATION

Tie-down rod elongation is computed between bearing plates (restraints). This design example has bearing plates located at each floor. Table 11 computes the rod capacities and elongations (per floor) between the bearing plates.

Table 11. Determine Rod Sizes, Capacities and Elongations

Level	Plate Height (ft)	Tension Demand (kips)	Rod Dia. d (in)	Eff. Dia. d _e (in)	A _g (in ²)	A _e (in ²)	F _u (ksi)	F _y (ksi)	Allow Rod Capacity	Rod Elong. (in)
									.75*F _u *A _g /2 (kips)	
Roof	10.0	2.32	0.625	0.527	0.307	0.226	58	36	6.68	0.042
6th Floor	10.0	5.33	0.625	0.527	0.307	0.226	58	36	6.68	0.098
5th Floor	10.0	10.86	0.625	0.527	0.307	0.226	120	105	13.82	0.199
4th Floor	10.0	17.77	0.875	0.755	0.601	0.462	120	105	27.05	0.159
3rd Floor	10.0	25.76	1.000	0.865	0.785	0.606	120	105	35.33	0.170

Notes for Table 11:

1. Tension demand (ASD uplift) values are computed in Table 10.

2. Rod area: $A_g = \frac{3.14d^2}{4}$

3. Net tensile area A_e is from AISC Table 7-17. $A_e = 0.7854 (d_b - 0.9743/n)^2$
where n = the number of threads per inch.

4. Standard rod is ASTM A36 rod with minimum F_u = 58 ksi, F_y = 36 ksi.
High-strength rod is ASTM A193 rod with minimum F_u = 125 ksi, F_y = 105 ksi for rods up to 2-1/2 inches in diameter and A449 rod with minimum F_u = 120 ksi, F_y = 105 ksi for rods up to 1 inch in diameter then drops to F_y = 81 ksi (per ASTM A449) for rods from 1 to 1-1/2 inches in diameter and drops to F_u = 90 ksi, F_y = 58 ksi (per ASTM A449) for rods from 1-3/4 to 3 inches in diameter.

5. Allowable rod capacity for the *AISC Steel Construction Manual Thirteenth Edition* is:

$$\frac{0.75F_u A_b}{2}$$

6. Rod elongation: $\Delta = \frac{PL}{A_e E}$

Where:

Δ = the elongation of the rod in inches

P = the accumulated uplift tension force on the rod in kips (tension demand)

L = length of rod in inches from bearing restraint to bearing restraint, with the bearing restraint being where the load is transferred to the rod

E = 29,000 ksi

A_e = the effective area of the rod in square inches

When smooth rods are used, the area is equal to the gross area (A_g). When threaded (all-thread) rods are used, the area is equal to the tension area (A_e) of the threaded rod. Since many of the proprietary systems that have smooth rods have long portions threaded at the ends, it is recommended that A_e be used when calculating rod elongation.



7. Rod elongation is based on using the effective area (A_e) and the following lengths:
 - a. For the first level, the anchor bolt is projecting 4 inches above the foundation (height of coupler nut to anchor bolt at podium slab).
 - b. For the framed floors, the rod from below is projecting 6 inches above the sole plate.
8. Rod diameters may need to be larger than what is required to meet the tension demands, with rod diameters increased to reduce rod elongations and shear wall deflections. Having a spreadsheet that is linked to the different tables allows the engineer to make rod diameter adjustments quickly without having to redo numerous calculations.

ROD COUPLERS

Couplers are used to connect the rods. Couplers can either be straight or reducing and can be supplied in different strengths or grades. Couplers for high-strength rods need to be of high-strength steel and are marked with notches or marks on the coupler. For a rod to develop its full strength, the rod must be a set amount (usually the depth of a standard nut). It is recommended that, when couplers are used, they have "pilot" or "witness" holes in the side so the threads of the rods can be witnessed in the holes to ensure proper embedment.

Reducing couplers are used when the rod size is changed. In reducing couplers, the size of the threading changes at the middle of the coupler device. It is intended that the rods be embedded until they bottom out at the center of the coupler. If the rods are installed in this fashion, "witness" holes will not be necessary; however, it is recommended that couplers with witness holes be used so that proper installation can be confirmed by an inspector. Reducing couplers should have the same notches and identifying marks as straight couplers when used with high-strength rods.

BEARING PLATES

Bearing plates transfer the tension load from the structure, the sole plate or the top plates into the rod (see Figure 14). Premanufactured bearing plates are usually identified by paint color or by a number marked on the plate. However, paint colors or unpainted plates vary among different rod system manufacturers.

Table 12. Determine Bearing Plate Sizes and Capacities

Level	Bearing Plate					Bearing Factor C_b	Bearing Load (kips)	Allowable Capacity (kips)
	Width (in)	Length (in)	Thickness (in)	Hole Area (in ²)	A_{Brg} (in ²)			
Roof	3.0	5.5	0.625	0.5185	15.982	1.07	2.319	10.669
6th Floor	3.0	3.5	0.375	0.5185	9.982	1.11	3.014	6.907
5th Floor	3.0	5.5	0.625	0.5185	15.982	1.07	5.530	10.669
4th Floor	3.0	5.5	0.625	0.8866	15.613	1.07	6.906	10.424
3rd Floor	3.0	5.5	0.625	1.1075	15.392	1.07	7.988	10.276

Notes for Table 12:

1. Bearing plate is based on ASTM A36 steel with $F_y = 36$ ksi.
2. Bearing area factor for $l_b < 6$ in:
$$C_b = \frac{(l_b + 0.375)}{l_b}$$

Bearing area factor for $l_b \geq 6$ in: $C_b = 1.0$

3. Bearing plate thicknesses shall be checked for bending using lengths governed by the area satisfaction check and the associated hole in the plate.

Example bending check of bearing plate at third floor:

Bearing plate size = 3.0 inches x 5.5 inches x 0.6 inches thick

Bearing load = 7,988 lbs (Table 12)

Bearing area for wood: subtracting for $\frac{3}{16}$ -inch oversized hole in wood plate

$$(16.5 - 1.1075) = 15.392 \text{ in}^2$$

$$f_{c\perp} = \frac{7,988}{15.392} = 519 \text{ psi}$$

$$F'_{c\perp} = F_{c\perp}C_b = 625 \times 1.07 = 669 \text{ psi} > 519 \text{ psi } \textit{Okay}$$

Steel plate bending check:

$$(519 \times 3.0) \times \frac{\left(\frac{5.5}{2}\right)^2}{2} = 5,887 \text{ in/lb}$$

$$Z_{\text{plate}} = \frac{bd^2}{4} = \frac{(3.0 - 0.9375) \times 0.6^2}{4} = 0.1856 \text{ in}^3$$

$$\frac{M}{Z} = \frac{5,887}{0.1856} = 31.7 \text{ ksi } \textit{Okay}$$

4. Allowable capacity: $F'_{c\perp}A_{Brg}C_b$

Where: $F'_{c\perp} = 0.669 \text{ ksi}$

5. The bearing area is based upon the sill plate hole diameter being $\frac{3}{16}$ -inch larger than the rod diameter.
6. Bearing load = differential load from Table 10.

BOLTED TIE-DOWN DEVICE ELEMENTS

Another type of tie-down device, illustrated in Figure 15, utilizes bolts instead of bearing plates to transfer the overturning forces to the continuous rods. In this system, posts need to transfer tension forces. Although this type of system is still available, most framing contractors prefer the bearing plate devices due to quicker/easier installation in the field.

TAKE-UP DEVICES

Most continuous rod systems have methods of compensating for shrinkage with proprietary expanding or contracting devices.

The purpose of these devices is to minimize the clearance created between the holdown, tension tie connector, or plate washer and the anchor bolt/nut due to building settlement or wood shrinkage. They keep rotating the nut down (or use a compression spring) on the rod so the holdown, tension tie or bearing plate remains tight to the wood surface.



ICC Evaluation Service has acceptance criteria (AC 316) for shrinkage compensating (take-up) devices. The design engineer should check to see that the proprietary devices conform to these criteria.

The use of take-up devices is highly desirable in multi-level wood-frame construction. Since the total shrinkage of the building has to be accounted for in the tie-down displacement (Δ_a), it is very difficult to meet the code drift requirements for most shear walls without take-up devices, especially for short-length shear walls.

Take-up devices deflect under load just like the conventional holdown. Most manufacturers publish this information either in their brochures or Evaluation Service reports. The deformation or initial slack of these devices needs to be considered in the overall tie-down displacement (Δ_a).

Take-up devices have moving parts and may jam if not properly installed. Jamming typically occurs as a result of excessive continuous tie rod angle (out-of-plumb). See the manufacturer's instructions for proper installation.

7. Considerations with Continuous and Discontinuous Anchor Tie-Downs

Continuous tie-downs have several advantages over conventional tie-downs—such as ease of installation and higher uplift capacities. Most conventional tie-downs (hold downs) do not offer the capacities needed for multi-level construction, or the shrinkage compensating devices that are available in continuous tie-down systems.

SKIPPING OF FLOORS FOR BEARING RESTRAINTS

To reduce costs, some manufacturers “skip” floors with the bearing restraint devices. In this design example, bearing devices may be omitted at the third and fifth floors with restraints at the fourth floor and roof locations. When floors are skipped, the magnitude of tie-down assembly displacement is accumulative between the bearing restraints and hence significantly increases the shear wall deflection(s). Skipping floors is not recommended.

BEARING ZONE THROUGH FRAMING

Compression loads to the boundary members (posts) are achieved by nailing the shear wall sheathing to each boundary member, thus transferring the overturning (compression) forces, and are accumulative to the stories below. As the shear wall transfers the overturning (tension) forces to the boundary members, these forces collect at each level (between restraint devices) and transfer the differential loads (see Table 10) to the bearing plates at the level above (see Figure 14). The engineer should consider how the differential uplift forces are transferred from the boundary members to the bearing plate. As a general rule, when the differential uplift forces can be transferred within a bearing area located within a 45 degree plane from the bearing plate, no further investigation is necessary (see Figure 14A). When the transfer of forces requires an area larger than the 45 degree plane, some sort of further investigation is necessary (e.g., bending and shear checks of top plates etc.).

Example bearing check (See Figure 14A):

Differential load at third floor = 7,988 lb (from Table 10)

Bearing plate width = 5.5 in (from Table 12)

Bearing width at bottom of 4x4 top plate = $(5.5 + 5.7 + 5.7) = 16.9$ in

Net bearing area = $(16.9 - 6.0) \times 3.5 = 38.1$ in²

Bearing stress = $7,988/38.1 = 210$ psi < 625 psi *Okay*

Posts at plate = $7,988/(2 \times 3.5 \times 7.25) = 157$ psi < 625 psi *Okay*

8. Shear Wall Deflection, Tie-Downs and Take-Up Devices

8a. Continuous Tie-Down Assembly Displacement


The continuous tie-down assembly displacement (Δ_a) is a collective accumulation of the deformation of tie-down elements. Each of these elements deforms, elongates and/or shrinks.

SDPWS-2008 now has a revised definition of Δ_a stated as follows:

“Total vertical elongation of wall anchorage system (including fastener slip, device elongation, rod elongation, etc.) at the induced unit shear in the wall.”

The net effect of the tie-down assembly displacement is a rotation of the shear wall, as a rigid body, with the displacement at the top of the wall (Δ) equal to the aspect ratio times the tie-down assembly displacement (Δ_a).

Figure 11. Effect of Δ_a on Drift

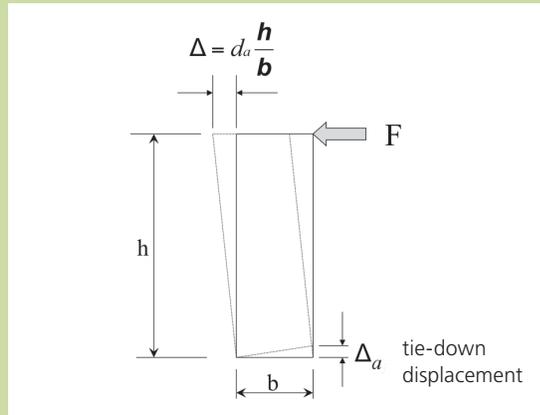

Notes for Figure 11:

Where: h = floor-to-floor height
 b = the out-to-out dimension of the shear wall

ROD ELONGATION

Some jurisdictions have limits on the amount of rod elongation that can occur between restraints, and some require that the “allowable stress area” (A_e vs. A_g) be used in rod elongation calculations. As such, local building department requirements should always be checked. This design example uses A_e for rod elongation and A_g or A_n for rod capacity. Many manufactures will vary the yield strength of the tension rods. It should be noted that the use of a higher strength rod can actually increase the drift of the shear wall, due to increased elongation from higher loads that can be placed on the same size rod diameters and the modulus of elasticity of the steel, which does not change.

For further discussion on rod elongation see §6i.



SILL PLATE CRUSHING

Per NDS-12 §4.2.6, when compression perpendicular to grain $f_{c\perp}$ is less than $0.73 F'_{c\perp}$, crushing will be approximately 0.02 inch. When $f_{c\perp} = F'_{c\perp}$, crushing is approximately 0.04 inch. The effect of sill plate crushing is the downward effect at the opposite end of the wall (resulting from the boundary chords) and has the same rotational effect as the tie-down displacement (Δ_a). Short walls that have no (net) uplift forces will still have a crushing effect at wall boundaries and contribute to rotation of the wall.

The crushing effect on wood is not linear; a graph of load versus deformation is shown in Figure 12. The values of 0.02 inch and 0.04 inch are based upon a *metal plate* bearing on wood perpendicular to grain under standard test conditions of ASTM D143. These values are limit state values and not adjustable for duration of load (C_D).

NDS Commentary §C4.2.6 states that when a joint is made of two wood members and both are loaded perpendicular to grain, the amount of deformation will be approximately 2-½ times that of a metal plate bearing joint. Table 13 lists the deformation adjustment factors for different bearing conditions. Excepting post caps and bases, most connections in wood construction do not have metal plates for bearing. In the case of our shear wall in the design example, the only metal plates in the wall construction are the bearing plates at the continuous tie-down rods. Accordingly, the crushing values of sill plates under boundary posts should be increased by the deformation adjustment factor shown in Table 13.

Table 13. Deformation Adjustment Factor for Bearing Condition

Bearing Condition	Deformation Adjustment Factor
1. Wood-to-wood (both perpendicular to grain)	2.5
2. Wood-to-wood (one parallel to grain and one perpendicular to grain)	1.75
3. Metal-to-wood (wood loaded perpendicular to grain)	1.0

For the three different regions of the load versus deformation curve shown in Figure 12, equations for determining compression perpendicular to grain deformation (Δ) may be calculated as follows:

Where: $f_{c\perp} \leq F_{c\perp 0.02 \text{ in}}$

$$\Delta = 0.02 \times \left(\frac{f_{c\perp}}{F_{c\perp 0.02 \text{ in}}} \right) \quad \text{Eq. 1.0}$$

Where: $F_{c\perp 0.02 \text{ in}} < f_{c\perp} < F_{c\perp 0.04 \text{ in}}$

$$\Delta = 0.04 - 0.02 \times \frac{1 - \left(\frac{f_{c\perp}}{F_{c\perp 0.04 \text{ in}}} \right)}{0.27 \text{ in}} \quad \text{Eq. 2.0}$$

Where: $f_{c\perp} > F_{c\perp 0.04 \text{ in}}$

$$\Delta = 0.04 \times \left(\frac{f_{c\perp}}{F_{c\perp 0.04 \text{ in}}} \right)^3 \quad \text{Eq. 3.0}$$

Where:


Δ = deformation, in

$f_{c\perp}$ = induced stress, psi

$F_{c\perp 0.04 \text{ in}} = F_{c\perp}$ = reference design value at 0.04 in deformation, psi ($F_{c\perp}$)

$F_{c\perp 0.02 \text{ in}}$ = reference design value at 0.02 in deformation, psi ($0.73 F_{c\perp}$)

Figure 12. $F_{c\perp}$ Load Deformation Curve
(Eq. 3.0 Derived from Bendtsen-Galligan, 1979)

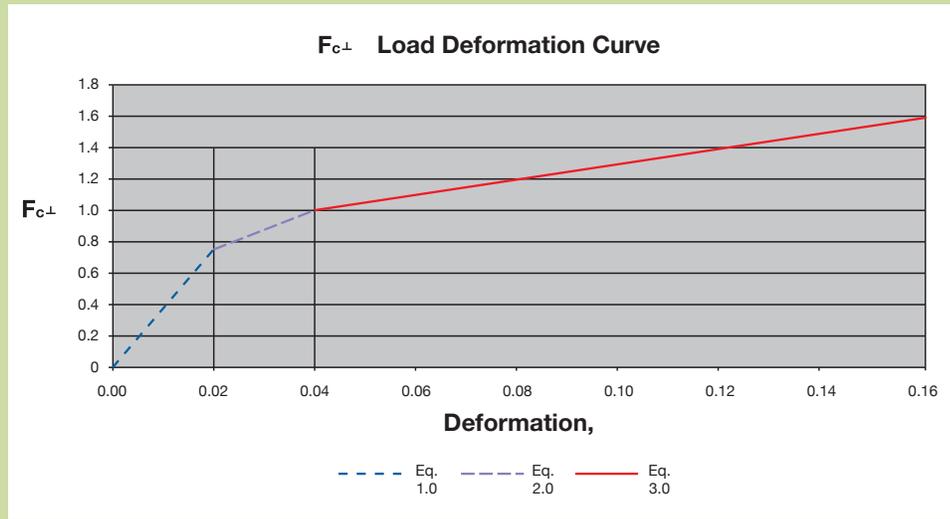

In the case of our shear wall in the design example (Figure 13, detail B), the boundary posts bear on the sill plate (bearing condition 2), the floor sheathing and the boundary posts bear on the underside of the top plate (bearing condition 2), and the “crushing effect” is coming from two directions at the same time, thus doubling the amount of deformation. In addition, there is the crushing effect of the floor sheathing. For “wood-to-wood” bearing condition 2 (Table 13), the deformation adjustment factor is 1.75. NDS does not have a “crushing value” for the wood structural panel floor sheathing and it is assumed to be higher than for sawn lumber. As a way of accounting for this, a deformation adjustment factor of 2.5 will be used in lieu of the 1.75 factor, producing a compounding effect of $2 \times 2.5 = 5.0$ times the values computed in Eq. 1.0, Eq. 2.0 or Eq. 3.0.

CRUSHING EFFECTS OF “UPLIFT” BOUNDARY MEMBERS

Differential strength uplift forces for the boundary chords transfer the story uplift forces to the metal bearing plate at the floor above (Figures 14 and 14A and §7); however, these differential uplift forces are less than the cumulative strength compression downward forces. Since the crushing effects have already been considered for the higher downward forces, there is no need to consider the lesser crushing effects of the uplift forces.

BUCKLING PERPENDICULAR TO GRAIN POTENTIAL

In addition to the wood-to-wood crushing effects described above, when a rim board is placed between the top plate(s) and the floor sheathing and there is a larger compressive load from boundary post(s), there is the potential for buckling of the rim board. This buckling effect can significantly increase the crushing effect and thus significantly increase the total displacement (Δ_a). In order to eliminate this buckling potential, it is recommended that a doubled rim board or squash blocks (Figure 13, detail A) be added. This design example utilizes modified balloon framing which eliminates this effect (Figure 13, detail B).



Table 14. Determine Sill Plate Crushing

Level	Chord Posts	ASD Demand (kips)	Strength Demand (kips)	Total Area (in ²)	f _{c⊥} (ksi)	0.73F'c⊥ (ksi)	Crush Δ (in)
Roof	4-3x4	3.81	5.27	35.0	0.151	0.487	0.031
6th Floor	4-3x4	12.21	16.11	35.0	0.460	0.505	0.091
5th Floor	4-4x8	26.05	33.40	101.5	0.329	0.487	0.068
4th Floor	4-4x8	39.72	51.07	101.5	0.503	0.487	0.108
3rd Floor	5-4x8	54.69	70.54	126.9	0.556	0.487	0.137

Where:

1. ASD demand and strength demand values are obtained from Table 8.

Table 15. Determine Bearing Plate Crushing

Level	ASD Bearing Load (kips)	Strength Bearing Load (kips)	Bearing Plate A _{brg} (in ²)	f _{c⊥} (ksi)	0.73F'c⊥ (ksi)	Crush Δ (in)
Roof	2.319	3.313	15.98	0.207	0.487	0.009
6th Floor	3.014	4.306	9.98	0.431	0.505	0.017
5th Floor	5.530	7.901	15.98	0.494	0.487	0.021
4th Floor	6.906	9.866	15.61	0.632	0.487	0.036
3rd Floor	7.988	11.412	15.39	0.741	0.487	0.054

Where:

1. ASD bearing load values are obtained from the differential loads of Table 10.
2. Strength bearing loads are obtained by dividing ASD bearing loads by the conversion factor of 0.7.
3. Note that the "allowable" F_{c⊥} has been exceeded at the fourth floor; however, this design example uses "strength" (LRFD) loads where the bearing resistance is:

$$F'_{c\perp} = \lambda\phi_c K_F F_{c\perp} C_b = 1.0 \times 0.9 \left(\frac{1.875}{0.9} \right) 625 \times 1.11 = 1,300 \text{ psi} > 741 \text{ psi Okay}$$

Also see ASD bearing plate capacities and bearing factors from Table 12.

Table 16. Determine Tie-Down Assembly Displacement (with Shrinkage Compensators)

Level	Rod Elong. (in)	Shrinkage (Vertical Displacement) (in)	Chord Crushing (in)	Bearing Plate Crushing (in)	Take-Up Deflection Elongation (in)	Total Displacement Δ_a (in)
Roof	0.069	0.03	0.031	0.009	0.030	0.17
6th Floor	0.173	0.03	0.091	0.017	0.030	0.343
5th Floor	0.345	0.03	0.068	0.021	0.030	0.495
4th Floor	0.270	0.03	0.108	0.036	0.030	0.476
3rd Floor	0.285	0.03	0.137	0.054	0.030	0.538

Table 16A. Determine Tie-Down Assembly Displacement (without Shrinkage Compensators)

Level	Rod Elong. (in)	Shrinkage (Vertical Displacement) (in)	Chord Crushing (in)	Bearing Plate Crushing (in)	Total Displacement Δ_a (in)	Accumulative Displacement Δ_a (in)
Roof	0.069	0.17	0.031	0.009	0.278	2.564
6th Floor	0.173	0.17	0.091	0.017	0.452	2.286
5th Floor	0.345	0.17	0.068	0.021	0.604	1.835
4th Floor	0.270	0.17	0.108	0.036	0.584	1.231
3rd Floor	0.285	0.17	0.137	0.054	0.647	0.647

Notes for Tables 16 and 16A:

Where:

1. Rod elongation is based on strength uplift forces from Table 10 and the rod lengths and A_e from Table 11.
2. Shrinkage values (vertical displacement) are obtained from Table 2; where shrinkage compensating devices are used, a value of $1/32$ inch is used, recognizing that most devices have to travel a distance before they get to the next "groove" in the device to re-adjust.
3. Chord crushing (crush) values are obtained from Table 14.
4. Bearing plate (crush) values are obtained from Table 15.
5. Take-up deflection elongation in Table 16 is from the manufacturer. Take-up deflection in Table 16A is 0.00 inches because the device has been omitted.
6. Without shrinkage compensators (Table 16A), the tie-down assembly displacements are accumulative from floor-to-floor level.



8b. Shear Wall Deflection

A considerable amount of monotonic and cyclic testing has been done on wood structural panel shear walls in the last two decades, most notably as part of the *CUREE-Caltech Woodframe Project*. Test results and testing protocols used in this project can be found in the references listed in the Commentary § C4.3 of the SDPWS-2008.

A well-known expression for shear wall deflection using the four sources of deflection has been found in IBC §2305.3. However, the 2012 IBC now only allows the equation for *stapled* shear walls; for determining the deflection for a *nailed* shear wall, the SDPWS-2008 must be used. The equation for calculating shear wall deflection is shown below.

$$\delta_{sw} = \frac{8vh^3}{EAb} + \frac{vh}{1,000G_a} + \frac{h}{b} \Delta_a \quad (\text{SDPWS-2008 Eq. 4.3-1})$$

Where:

v = induced unit shear in the wall in pounds per linear foot, plf

h = height from the bottom of the sill plate to the underside of the framing at diaphragm level above (top plates), ft

E = modulus of elasticity of the boundary posts, psi

E = 1,700,000 psi

A = area of the boundary element in square inches (3x4 or 4x8 posts in this design example)

At the roof, the boundary elements consist of four 3x4s

At the floor, the boundary elements consist of four 4x8s

b = the shear wall length in ft

G_a = apparent shear wall stiffness from nail slip and panel deformation (kips/in) from column A, Tables 4.3A, 4.3B, 4.3C or 4.3D. When 4-ply or 5-ply plywood panels or composite panels are used, G_a values may be increased by 1.2.

Δ_a = total vertical displacement of the anchorage system due to anchorage details (including fastener slip, device elongation, rod elongation etc.) at the induced unit shear in the wall, in.

The above equation is actually a simplified equation from a more complex four-term equation. This four-term equation adds the effects of the four sources contributing to the deflection: the cantilever bending of the boundary members, the shear deformation of the wood structural panels, the bending and slip of the fasteners and the deflection due to the anchorage (tie-down) deformation. The original more complex four-term shear wall deflection formula is shown below.

$$\delta_{sw} = \frac{8vh^3}{EAb} + \frac{vh}{G_v G_t} + 0.75he_n + \frac{h}{b} \Delta_a \quad (\text{SDPWS-2008 Eq. C4.3.2-1})$$

Where:

$G_v G_t$ = shear stiffness (lbs/in) of panel depth Tables C4.2.2A and C4.2.2B

e_n = nail deformation (fastener slip)

Using the fastener slip equations from SDPWS-2008, Table C4.2.2D for 10d common nails, there are two basic equations.

When the nails are driven into *green* lumber

$$e_n = (V_n/977)^{1.894}$$

When the nails are driven into *dry* lumber

$$e_n = (V_n/769)^{3.276}$$

Where:

V_n is the fastener load in pounds per fastener

The simplified expression using three terms (Eq. 4.3-1) combines the second and third terms of the four-term equation into one term. Computed deflections by using either the four-term equation or the three-term equation produce nearly identical results at the critical strength level (1.4 times the allowable shear values for seismic). Thus either equation may be used for computing the deflection of a shear wall.

Although equation 4.3-1 is easier to use, the deflections computed will be slightly larger than the actual since the apparent shear wall stiffness (G_a) listed in Tables 4.3A, 4.3B, 4.3C or 4.3D are based upon the shear in the wall being at its capacity for the given nailing. For more accurate estimates of deflection at load levels less than the unit shear capacity of the shear wall, the four-term equation can be used with the the calculated e_n values based on the unit shear capacity of interest. Alternatively, the four-term equation can be used with the calculated e_n values. Both equations need to be adjusted to site conditions (moisture content of lumber, OSB panels vs. plywood panels, number of plies in the panels, etc.).



Table 17. Determine Shear Wall Deflection (using Shrinkage Compensating Devices)

Level	ASD Shear (plf)	Strength Shear # Sides Sheathing (plf)	h (ft)	A (in ²)	b (ft)	G _a (k/in)	Nail Spacing (in)	Total Displacement Δ _a (in)	Deflection δ _{xe} (in)
Roof	314	448	10.0	35.0	29.0	14	6	0.17	0.38
6th Floor	587	838	10.0	35.0	29.0	23	2	0.343	0.49
5th Floor	794	567	10.0	101.5	29.0	23	2	0.495	0.42
4th Floor	932	666	10.0	101.5	29.0	23	2	0.476	0.45
3rd Floor	1,001	715	10.0	126.9	29.0	23	2	0.538	0.50

Table 17A. Determine Shear Wall Deflection (without Shrinkage Compensating Devices)

Level	ASD Shear (plf)	Strength Shear # Sides Sheathing (plf)	h (ft)	A (in ²)	b (ft)	G _a (k/in)	Nail Spacing (in)	Total Displacement Δ _a (in)	Deflection δ _{xe} (in)
Roof	314	448	10.0	35.0	29.0	14	6	2.564	1.21
6th Floor	587	838	10.0	35.0	29.0	23	2	2.286	1.16
5th Floor	794	567	10.0	101.5	29.0	23	2	1.835	0.88
4th Floor	932	666	10.0	101.5	29.0	23	2	1.231	0.71
3rd Floor	1,001	715	10.0	126.9	29.0	23	2	0.647	0.54

Where:

$$\delta = \frac{8vh^3}{EAb} + \frac{vh}{1,000G_a} + d_a \frac{h}{b}$$

Comparing shear wall deflections, the shear walls without shrinkage compensating devices were found to deflect over three times more at the roof level than those with these devices. Further, the magnitude of the increased deflection increases significantly as the length of the shear wall decreases and the ratio of h/b becomes larger.

Note that some jurisdictions require the calculated drifts to be increased by 1.25 to account for dynamic cyclic effects on the wall that could reduce its stiffness.

Footnote 4 of SDPWS Table 4.3A allows a 20% increase in G_a values when 4- or 5-ply plywood panels or composite panels are used.

8c. Story Drift Determination

ASCE 7-10 §12.8.6

The code states that when allowable stress design is used, the computed story drift δ_{xe} shall be computed using strength-level seismic forces specified in ASCE 7-10 §12.8 without the reduction for allowable stress design.

For light-frame walls sheathed with wood structural panels rated for shear resistance, the design story drift is computed as follows:

$$\delta_x = \frac{C_d \delta_{xe}}{\ell}$$

Where:

δ = design story drift

C_d = deflection amplification factor from ASCE 7-10 Table 12.2-1

$C_d = 4.0$

ℓ = occupancy factor

$\ell = 1.0$

δ_{xe} = calculated deflection at the top of the wall

$$\delta_x = \frac{4.0 \delta_{xe}}{1.0} = 4.0 \delta_{xe}$$

The calculated story drift using δ_x shall not exceed the maximum allowable which is 0.025 times the story height h for structures four stories or less in height. The calculated story drift shall not exceed 0.020 times the story height h for structures five stories or more in height. Since the overall building is six stories, the drift limit is 0.020 h .



DETERMINATION OF MAXIMUM DRIFTS

ASCE 7-10 Table 12.12-1

Table 18. Determine Shear Wall Drift vs. Allowable Drifts (with Shrinkage Compensators)

Level	Deflection δ_{xe} (in)	h (ft)	Story Design Drift $4.0\delta_{xe}$ (in)	Code Max. Allowable (in)
Roof	0.38	10.0	1.52	2.40
6th Floor	0.49	10.0	1.95	2.40
5th Floor	0.42	10.0	1.67	2.40
4th Floor	0.45	10.0	1.82	2.40
3rd Floor	0.50	10.0	1.99	2.40

Table 18A. Determine Shear Wall Drift vs. Allowable Drifts (without Shrinkage Compensators)

Level	Deflection δ_{xe} (in)	h (ft)	Story Design Drift $4.0\delta_{xe}$ (in)	Code Max. Allowable (in)
Roof	1.21	10.0	4.83	2.40
6th Floor	1.16	10.0	4.63	2.40
5th Floor	0.88	10.0	3.52	2.40
4th Floor	0.71	10.0	2.86	2.40
3rd Floor	0.54	10.0	2.14	2.40

Notes for Tables 18 and 18A:

Shear wall drifts do not include the diaphragm deflections between the shear walls but are considered negligible for this design example.

For the 29-foot-long wall used in this design study, the shear wall with the shrinkage compensating devices meets the drift requirements but the shear wall without the shrinkage compensating devices exceeds the drift requirements at all levels except the third floor.

Story design drifts initially exceeded the code maximum allowable and required increasing the rod diameters (Table 11) to reduce rod elongations and shear wall deflections.

8d. Load Path for Rod Systems


COMPRESSION MEMBERS

When the shear wall end is in compression, the end chord members create a compression bearing path from the posts through blocking at the floor levels and then to the next set of posts below (Figure 13).

TENSION RODS

When the shear wall end is in tension, the end chord members lift up and bear in compression on the floor (or roof) above. The bearing plate (load transfer device) resists the individual story overturning by restraining the posts below from uplifting (Figure 14). The bearing plates transfer the uplifting forces from the posts to the tension rod.

Figure 13. Load Transfer from Compression Posts to Compression Posts

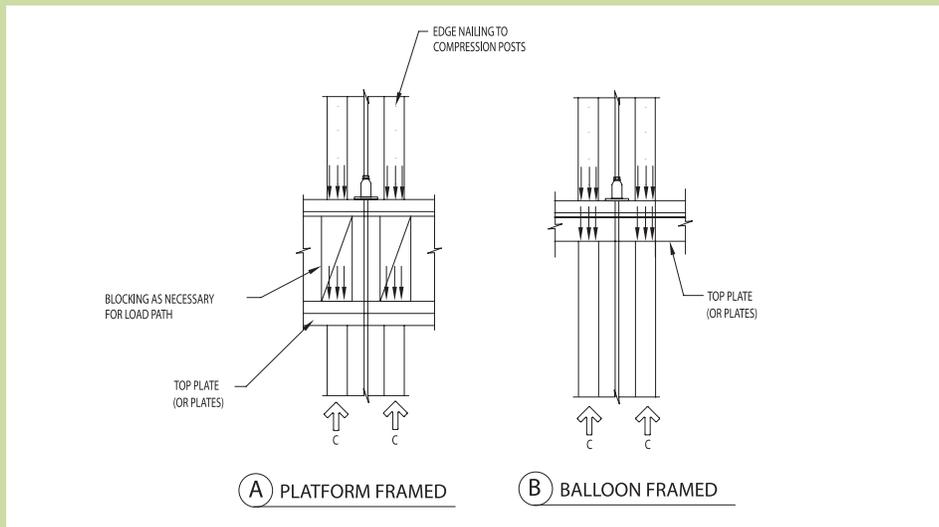


Notes for Figure 13:

Detail A (at platform framed) may have a single block with a drilled hole for the tie-down rod (see Figure 15).



Figure 14. Load Transfer from Uplifting Posts to Bearing Device

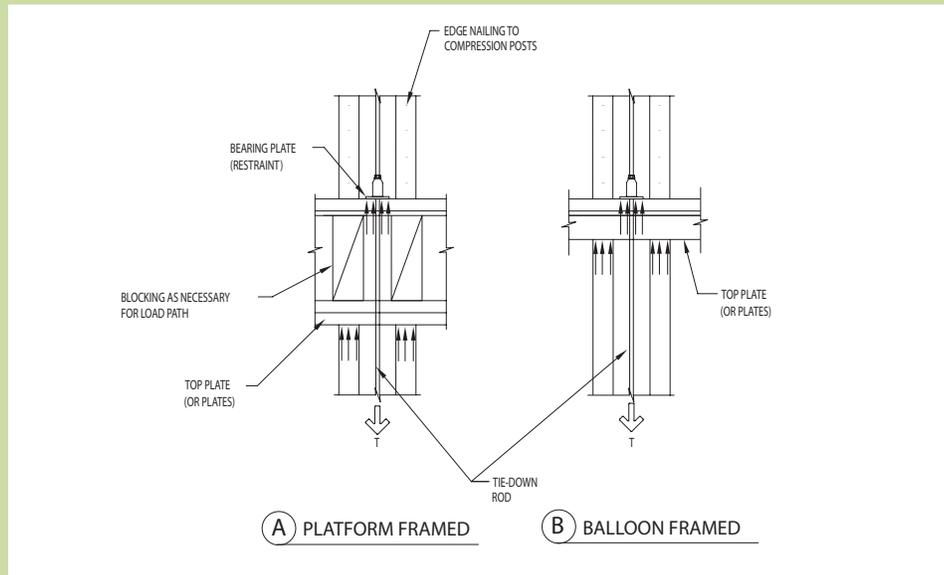

Notes for Figure 14:

Detail A (at platform framed) may have a single block with a drilled hole for the tie-down rod (see Figure 15).

Figure 14A. Bearing Zone Through Framing from Uplifting Posts to Bearing Device


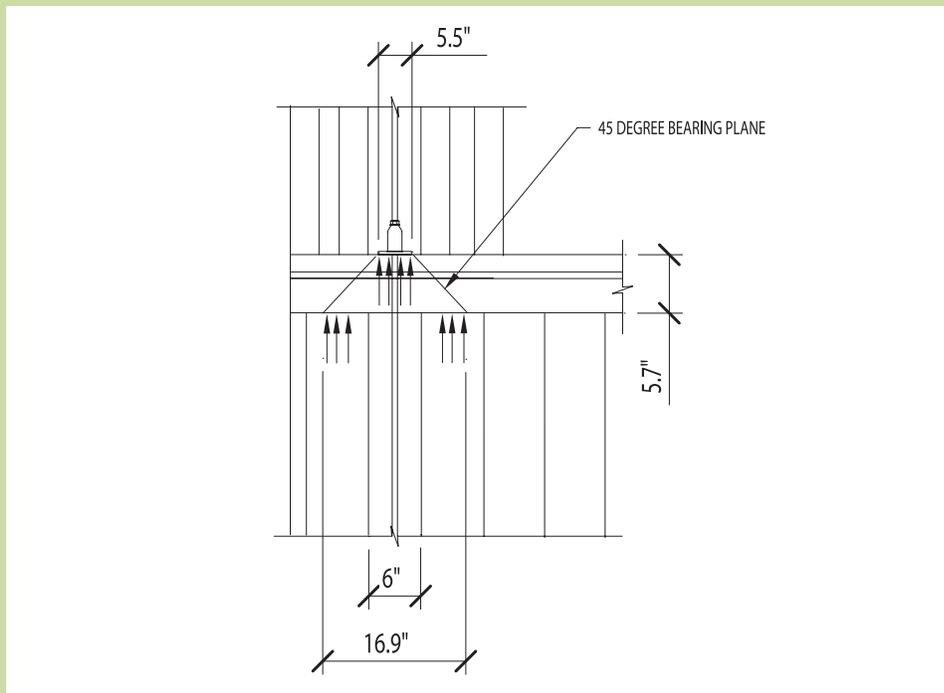


Figure 15. Load Transfer from Uplifting Posts to Bolted Device

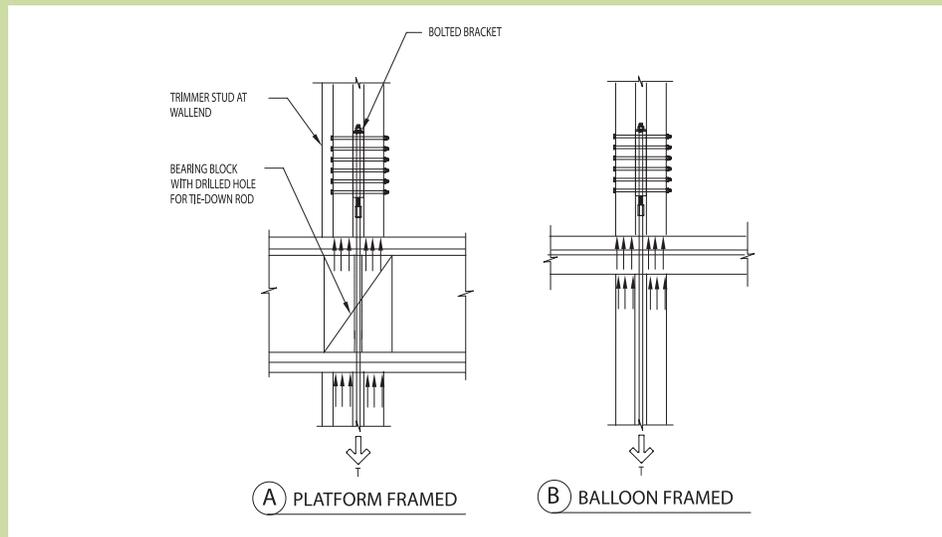

8e. Proprietary Software for Continuous Tie-Down Systems

Several continuous tie-down system manufacturers offer design software to aid the design engineer in the proper selection of their products as well as the proper selection of the compression chord members. The use of these software programs can be a big time saver for the engineer.

9. Discontinuous System Considerations and the Overstrength (Ω) Factor

9a. Anchor Forces to Podium Slab

For over 20 years, the building codes have had requirements to use amplified seismic forces in the design of elements supporting discontinuous systems. Earlier editions of the codes used the term $3R_w/8$, while current codes use the term Ω_o . ASCE 7-10 §12.3.3.3 requires amplification of seismic loads in the design of structural elements supporting discontinuous walls. Previous editions of the IBC and the *1997 Uniform Building Code* exempted concrete slabs supporting light-frame construction from these requirements. However, ASCE 7-10 does not have this exception thus adding “slabs” to the list of elements needing the design strength to resist the maximum axial force that can be delivered per the load combinations with the overstrength factor (Ω) in ASCE 7-10 §12.4.3.2.

This means that the shear wall boundary overturning forces (axial uplift and axial compression) need to have the Ω factor of 3.0 applied to the supporting slab design. Footnote g of ASCE 7-10 Table 12.2-1 states that, for structures with flexible diaphragms, this value may be 2.5. It should be noted that the overstrength factor does not need to be applied to the shear wall’s connections. ASCE 7-10 §12.3.3.3 states that the connections of the discontinuous wall to the supporting element need only be adequate to resist the forces for which the discontinuous wall was designed. The expanded commentary (3rd printing of ASCE 7-10) of §12.3.3.3 provides further explanation:



“For wood light-frame shear wall construction, the final sentence of §12.3.3.3 results in the shear and overturning connections at the base of a discontinued shear wall (i.e., shear fasteners and tie-downs) being designed using the load combinations of §2.3 or 2.4 rather than the load combinations with overstrength factor of §12.4.3.”

However, Appendix D of ACI 318, *Building Code Requirements for Structural Concrete*, does apply a factor similar to an overstrength factor to brittle concrete breakout failure modes if they govern the anchorage design. It is common to have anchorage to the podium slab not fall within the scope of ACI 318 Appendix D because of edge distances or available embedment lengths. Other means of bolt anchorage commonly used include “through bolting” or “sleeves” for post-installed through bolts, embed plates with welded studs, bearing plate washers at the bolt nut, or special steel reinforcing bars used in conjunction with the anchor bolts/bearing plates.

As discussed in ASCE 7-10 §12.4.3.1, one possible route to reduce the calculated overstrength load occurs when it can be shown that yielding of other elements (anchor, shear wall, diaphragm, collector, etc.) will occur below the overstrength-level forces. When this is the case, the seismic load effects including overstrength can be reduced to a lower value. ASCE 7-10’s commentary on §12.4.3 provides further explanation:

“The standard permits the seismic load effects, including overstrength factor, to be taken as less than the amount computed by applying ϕ_o to the design seismic forces where it can be determined that yielding of other elements in the structure limits the amount of load that can be delivered to the element and, therefore, the amount of force that can develop in the element.”

Part IV – Wind vs. Seismic Design with Wind Controlling

10. Use of Gypsum Board for Lateral Resistance

Allowable shear values (ASD) for wind and seismic forces for gypsum board shear walls can be found in IBC Table 2306.3(3). The SDPWS includes nominal shear values for wind and seismic in Table 4.3C and must be converted to ASD by dividing by an ASD reduction factor of safety of 2.0 or converted to LRFD by multiplying by a resistance factor of 0.8.

Per code, gypsum board may be used to resist lateral wind forces; however, allowable shear values for wind loads range from 60 to 250 pounds per lineal foot.

Using gypsum board for lateral resistance from *seismic* forces has limitations. The first is that the shear walls are subject to the limitations of ASCE 7-10 §12.2.1. Section 12.2.1 requires that the lateral force-resisting system be assigned the response modification coefficient R and the height limitations and permitted usages from Table 12.2-1. This table assigns significantly lower R -factors for shear panels with “other materials” than it assigns for walls with wood structural panel sheathing. The “other materials” include gypsum board, plaster and plaster over gypsum lath. These other materials are much less ductile than the wood structural panel shear walls. Table 12.2-1 assigns the response modification coefficient R of 2 for “bearing walls” with other materials and an R of 2.5 for non-bearing “building frame” systems. Both gypsum board and plaster have shown brittle failure in testing. Brittle failure is usually the complete separation of the board or plaster from the framing studs, making the wall unable to resist any lateral loads at all. Comparing the R -factor for wood structural panel sheathing, the values are 6.5 and 7 respectively. This means that, for bearing walls using other materials, the particular wall must be designed for a seismic force that is 225 percent higher than if the same wall had wood structural panel sheathing.

The second limitation is the fact that buildings in SDC D using shear walls with other materials are limited in height to 35 feet. The third is that using shear walls with other materials is not permitted in SDC E or F.

Depending on the SDC and the basic wind speed for a given building, it may be necessary to design the building’s seismic resistance using wood structural panels and then its wind resistance using a combination of the wood structural panels and additional shear walls using gypsum wallboard. For instance, a building in SDC B or C using gypsum wallboard shear walls with an R -factor of 2 would make seismic “control” the design and the higher design force would produce a design that did not have enough wall lengths to use gypsum wallboard, thus necessitating the use of wood structural panels. If the same design first used an R -factor of 6.5, the design seismic forces would only be 30 percent of the forces for using the R -factor of 2. For the shear walls with wood structural panels in the transverse direction in this design example, shear walls may only be required in every fourth party wall (52 feet on center); for wind design, gypsum wallboard shear walls may be required at every party wall (13 feet on center). See Figures 1 and 2.

The following wind design example illustrates a building using gypsum wallboard shear walls throughout except where required on the lower levels. The building is located adjacent to open terrain consisting of grass field and trees less than 30 feet tall; this terrain falls within the Surface Roughness C category in ASCE 7-10 §26.7. Additionally, the building is located in SDC A.



11. Use of Cooler Nails vs. Screws for Gypsum Board Fastening

Traditionally, gypsum wallboard has been fastened by cooler nails which are hand nailed using a hammer. Lately, the trade has evolved to using drywall screws and installing the screws with a drywall screw gun. The wallboard panels are typically hung by first “tacking” them in place with cooler nails, then when all the panels have been hung, installing the remainder of the fasteners with drywall screws using a screw gun. These screw guns are high speed and have sensors that automatically terminate the driving at a specific depth. This allows the contractor to “set and forget,” making screw installation consistent and quick. Some of the screw guns also have auto feed devices, making installation even quicker. Overall this installation method is quicker than the “hand nailed” method. However, from a lateral force-resisting perspective, the allowable (and nominal) values are significantly lower for screw fastened walls as compared with nail fastened walls. The reason for the reduction in allowable shear loads reflected in the tables is that, when the wall deflects under lateral loading, the fastener bends with the wall movement and the threads of the screw tend to “cut” a hole in the drywall material much larger than would be the case with cooler nails. It could be extremely problematic if the design engineer used the values for “nail fastened” walls and the contractors instead used “screws.” The design engineer may not even be aware of what fasteners were used, since the walls are often “taped and mudded” shortly after the fastener installation is complete. For this reason, it is recommended that the design engineer use the values for screw fastened wallboard. It should also be noted that typical gypsum wallboard is attached with “floating” corners and edges (i.e., builders don't attach the gypsum wallboard to the plates, but rather float the corners together with tape and joint compound. These walls do not have the shear capacity for a gypsum wallboard shear wall more like 30-60 plf for ASD.

12. Wind Loading Analysis – Main Wind Force-Resisting System

Design per ASCE 7-10 *Code for Enclosed or Partially Enclosed Buildings*

DESIGN CHECKLIST:

1. Determine appropriate wind method (Directional Procedure or Envelope Procedure)
2. Determine design coefficients
3. Determine parapet wind pressure
4. Determine leeward wall wind pressure
5. Determine windward wall wind pressure
6. Determine wind pressure on building

MAIN WIND FORCE-RESISTING SYSTEM

This design example uses Part 1 of the Directional Procedure to determine the wind loads for the main wind force-resisting system (MWFRS) per ASCE 7-10 §27.2. This method can be used for structures that are not considered low-rise when the building is regular in shape and has no special wind effects.

12a. Determination of Design Coefficients for Transverse Direction

Wind Exposure C	ASCE 7-10 §26.7
Wind Velocity $V = 115$ mph	ASCE 7-10 Figure 26.5-1A
Risk Category II	ASCE 7-10 Table 1.5-1
Topographic Factor $K_{zt} = 1.0$	ASCE 7-10 §26.8.2
Wind Directionality Factor $K_d = 0.85$	ASCE 7-10 Table 26.6-1
Gust Effect Factor (Rigid Structures) $G = 0.85$	ASCE 7-10 §26.9.1

Table 19. Determination of Wind Pressures on Building for the Transverse Direction

Level x	Windward Pressure					Leeward Pressure					Total	
	h_x	K_z	q_z	p-C1	p-C2	h_x	K_z	q_z	p-C1	p-C2		p
	(ft)		(psf)	(psf)	(psf)	(ft)		(psf)	(psf)	(psf)		
Parapet	65.0	1.156	33.264	49.896		65.0	1.156	33.264	-33.264		83.16	
Roof	62.0	1.144	32.934	28.324	16.467	62.0	1.144	32.934	-1.789	-13.645	30.11	
6	52.0	1.103	31.737	27.510	15.653	62.0	1.144	32.934	-1.789	-13.645	29.30	
5	42.0	1.054	30.342	26.561	14.704	62.0	1.144	32.934	-1.789	-13.645	28.35	
4	32.0	0.996	28.654	25.413	13.556	62.0	1.144	32.934	-1.789	-13.645	27.20	
3	22.0	0.920	26.480	23.935	12.078	62.0	1.144	32.934	-1.789	-13.645	25.72	
2	12.0	0.849	24.429	22.540	10.683	62.0	1.144	32.934	-1.789	-13.645	24.33	
Base	0.0	0.849	24.429	22.540	10.683	62.0	1.144	32.934	-1.789	-13.645	24.33	

C1 = Case 1; C2 = Case 2



Where:

PARAPET WIND PRESSURE:

Velocity Pressure Exposure Coefficient $K_z = 1.156$

ASCE 7-10 §27.3.1, Table 27.3-1, Case 2

Velocity Pressure $q_z = 0.00256 K_z K_{zt} K_d V^2$

ASCE 7-10 Eq. 27.3-1

Combined net pressure coefficients

$GC_{pn} = +1.50$ windward

$GC_{pn} = -1.0$ leeward

Combined net pressure on parapet

ASCE 7-10 Eq. 27.4-4

$p_p = q_p GC_{pn}$

LEEWARD WALL WIND PRESSURE:

$h = 62.0$ ft (mean roof height)

$L = 189$ ft $B = 76$ ft $L/B = 2.49$

Velocity Pressure Exposure Coefficient

ASCE 7-10 §27.3.1, Table 27.3-1, Case 2

$K_h = 1.144$

Velocity Pressure

ASCE 7-10 Eq. 27.3-1

$q = q_h = q_i = 0.00256 K_h K_{zt} K_d V^2$

$q_h = 17.99$ psf

External Pressure Coefficient

$C_p = -0.276$ leeward from interpolation

ASCE 7-10 Figure 27.4-1

$GC_{pi} = -0.18$

ASCE 7-10 Table 26.11-1

Design Wind Pressure

ASCE 7-10 Eq. 27.4-1

$p = q_h GC_p - q_i (GC_{pi})$

Case 1: Internal pressure inward:

ASCE 7-10 Table 26.11-1,

$p - C1 = -0.977$ psf

Case 2 per note 3

Case 2: Internal pressure outward:

ASCE 7-10 Table 26.11-1,

$p - C2 = -7.45$ psf

Case 2 per note 3

WINDWARD WALL WIND PRESSURE:

Velocity Pressure Exposure Coefficient

ASCE 7-10 §27.3.1, Table 27.3-1

$K_z =$ (see Table 19)

Velocity Pressure

ASCE 7-10 Eq. 27.3-1

$q = q_z = 0.00256 K_z K_{zt} K_d V^2$

External Pressure Coefficient

ASCE 7-10 Figure 27.4-1

$C_p = 0.80$ windward

Design Wind Pressure

ASCE 7-10 Eq. 27.4-1

$p = q_z GC_p - q_i (GC_{pi})$

12b. Determination of Design Coefficients for Longitudinal Direction

Wind Exposure C	ASCE 7-10 §26.7
Wind Velocity $V = 115$ mph	ASCE 7-10 Figure 26.5-1A
Risk Category II	ASCE 7-10 Table 1.5-1
Topographic Factor	ASCE 7-10 §26.8.2
$K_{zt} = 1.0$	
Wind Directional Factor	ASCE 7-10 Table 26.6-1
$K_d = 0.85$	
Gust Effect Factor (Rigid Structures)	ASCE 7-10 §26.9.2
$G = 0.85$	

Table 19A. Determination of Wind Pressures on Building for the Longitudinal Direction

Level x	Windward Pressure					Leeward Pressure					Total
	h_x (ft)	K_z	q_z (psf)	p-C1 (psf)	p-C2 (psf)	h_x (ft)	K_z	q_z (psf)	p-C1 (psf)	p-C2 (psf)	
Parapet	65.0	1.156	33.264	49.896		65.0	1.156	33.264	-33.264		83.16
Roof	62.0	1.144	32.934	28.324	16.467	62.0	1.144	32.934	-8.069	-19.925	36.39
6	52.0	1.103	31.737	27.510	15.653	62.0	1.144	32.934	-8.069	-19.925	35.58
5	42.0	1.054	30.342	26.561	14.704	62.0	1.144	32.934	-8.069	-19.925	34.63
4	32.0	0.996	28.654	25.413	13.556	62.0	1.144	32.934	-8.069	-19.925	33.48
3	22.0	0.920	26.480	23.935	12.078	62.0	1.144	32.934	-8.069	-19.925	32.00
2	12.0	0.849	24.429	22.540	10.683	62.0	1.144	32.934	-8.069	-19.925	30.61
Base	0.0	0.849	24.429	22.540	10.683	62.0	1.144	32.934	-8.069	-19.925	30.61

C1 = Case 1; C2 = Case 2

Where:

PARAPET WIND PRESSURE:

Velocity Pressure Exposure Coefficient	ASCE 7-10 §27.3.1, Table 27.3-1, Case 2
$K_z = 1.156$	
Velocity Pressure	ASCE 7-10 Eq. 27.3-1
$q_z = 0.00256 K_z K_{zt} K_d V^2$	
$GC_{pn} = +1.50$ windward	
$GC_{pn} = -1.0$ leeward	
Design Wind Pressure	ASCE 7-10 Eq. 27.4-4
$p_p = q_p GC_{pn}$	



LEEWARD WALL WIND PRESSURE:

$h = 62.0$ ft (mean roof height)

$L = 76$ ft $B = 189$ ft $L/B = 0.40$

Velocity Pressure Exposure Coefficient

$K_h = 1.144$

ASCE 7-10 §27.3.1, Table 27.3-1, Case 2

Velocity Pressure

$q = q_h = q_i = 0.00256 K_h K_{zt} K_d V^2$

ASCE 7-10 Eq. 27.3-1

$q_h = 17.99$ psf

External Pressure Coefficient

$C_p = -0.50$ leeward

ASCE 7-10 Figure 27.4-1

$GC_{pi} = -0.18$

ASCE 7-10 Table 26.11-1

Design Wind Pressure

$p = q_h GC_p - q_i (GC_{pi})$

ASCE 7-10 Eq. 27.4-1

Case 1: Internal Pressure Inward:

$p - C1 = -4.41$ psf

ASCE 7-10 Table 26.11-1

Case 2 per note 3

Case 2: Internal Pressure Outward:

$p - C2 = -10.89$ psf

ASCE 7-10 Table 26.11-1, note 3

WINDWARD WALL WIND PRESSURE:

Velocity Pressure Exposure Coefficient

$K_z =$ (see Table 19A)

ASCE 7-10 §27.3.1, Table 27.3-1

Velocity Pressure

$q = q_z = 0.00256 K_z K_{zt} K_d V^2$

ASCE 7-10 Eq. 27.3-1

External Pressure Coefficient

$C_p = 0.80$ windward

ASCE 7-10 Figure 27.4-1

Design Wind Pressure

$p = q_z GC_p - q_i (GC_{pi})$

ASCE 7-10 Eq. 27.4-1

13. Seismic Loading Analysis

13a. Design Base Shear

DESIGN CHECKLIST:

1. Determine Risk Category and Importance Factor
2. Determine S_S , S_1 and soil profile from site location
3. Determine S_{DS} and S_{D1}
4. Determine SDC
5. Determine F_x

Determine Risk Category and Importance Factor:

Risk Category: II

ASCE 7-10 Table 1.5-1

Importance Factor $I = 1.0$

Determine S_S , S_1 and soil profile:

Site Class D (based on geotechnical investigation)

Without a geotechnical investigation, Site Class D needs to be used as the default value.

Values for S_S and S_1 can be determined from ASCE 7-10 maps or from the U.S. Geological Survey (USGS) website, which provides the values by either zip code or longitude and latitude coordinates. It is recommended that the longitude and latitude coordinates (which can be obtained from the street address) be used.

USGS website link: <http://earthquake.usgs.gov/designmaps/us/application.php>

Download the JAVA Ground Motion Parameter Calculator and enter the latitude and longitude.

Note: Using Zip Code S_S is overstated 3 percent

Location: Comstock Park, MI 49321

Therefore from USGS application:

$$S_S = 0.069$$

(Site Class B)

$$S_1 = 0.043$$

(Site Class B)

$$F_a = 1.6$$

ASCE 7-10 Table 11.4-1

$$F_v = 2.4$$

ASCE 7-10 Table 11.4-2

$$S_{MS} = F_a S_S = 1.6(0.069) = 0.1104$$

ASCE 7-10 Eq. 11.4-1

$$S_{M1} = F_v S_1 = 2.4(0.043) = 0.098$$

ASCE 7-10 Eq. 11.4-2

$$S_{DS} = \frac{2}{3} S_{MS} = \frac{2}{3} (0.1104) = 0.074$$

ASCE 7-10 Eq. 11.4-3

$$S_{D1} = \frac{2}{3} S_{M1} = \frac{2}{3} (0.098) = 0.065$$

ASCE 7-10 Eq. 11.4-4



Determine SDC:

$$S_{DS} = 0.074g < 0.167$$

Therefore, SDC A

$$S_{D1} = 0.065g < 0.067$$

Therefore, SDC A

$$F_x = 0.01 W_x$$

ASCE 7-10 §11.7, Eq. 1.4-1

For the building as a whole

$$W = 5,799 \text{ k}$$

14. Wind and Seismic Forces to Typical Interior Transverse Wall

Table 20 compares seismic and wind force for the shear walls in the transverse direction. The lateral loads are determined from ASCE 7-10 which sets forth strength design seismic loads and allowable stress design wind loads.

Table 20. Wind and Seismic Forces to Typical Interior Transverse Wall

Level	ASD Seismic				ASD Wind				Control
	Trib Area ⁴ (ft. ²)	w _x (k)	F _x ¹ (lb)	F _{Total} (lb)	Trib Area ³ (ft. ²)	p (k)	F (lb)	F _{Total} (lb)	
Parapet					39	83.16	3,243		Wind
Roof	3,380	587	1,653	1,653	65	30.11	1,957	5,200	Wind
6th	3,380	639	1,800	3,453	130	29.30	3,809	9,009	Wind
5th	3,380	647	1,822	5,276	130	28.35	3,686	12,695	Wind
4th	3,380	647	1,822	7,098	130	27.20	3,536	16,231	Wind
3rd	3,380	647	1,822	8,920	130	25.72	3,344	19,574	Wind

Notes for Table 20:

$$1. F_x = 0.01x \left(\frac{\text{Trib Area}}{\text{Total Area}} \right) x w_x$$

Since this design example is located in SDC A, vertical distribution of forces per ASCE 7-10 §12.8.3 is not necessary. Since the vertical distribution of forces is not necessary, the need to use a two-stage design for the seismic lateral analysis is also not necessary.

- Total area = 12,000 ft²
- Tributary area for wind in transverse direction is the story height × wall spacing, where the shear walls are spaced at every wall at 13.0 feet on center. Tributary area for the roof level is one-half the story height × wall spacing plus the parapet × wall spacing.
- Tributary area for seismic in transverse direction is the building depth (65.0 ft) × wall spacing, where the shear walls are spaced at every fourth wall at 52.0 feet on center.

14a. Determination of Shear Wall Fastening

Table 21. Determination of Shear Wall Fastening

Level	F _{Total} ⁵ (lb)	Wall Length (ℓ) ⁴ (ft)	Panels Used ⁶	ASD Design				
				$V = \frac{F_{Total}}{\ell}$ (No sides) (plf)	Wall Sheathed 1 or 2 sides	Allowable Shear ¹ (plf)	Fastener Edge Spacing ^{2,3} (in)	Blocking
Roof	3,120	58.0	5/8-in Gypsum Board	27	2	70	8/12	Unblocked
6th Floor	5,406	58.0	5/8-in Gypsum Board	47	2	70	8/12	Unblocked
5th Floor	7,617	58.0	5/8-in Gypsum Board	66	2	70	8/12	Unblocked
4th Floor	9,739	58.0	5/8-in Gypsum Board	84	2	90	8/12	Blocked
3rd Floor	11,745	58.0	3/8-in Wood Structural Panel	202	1	203	6/12	Blocked

Notes for Table 21:

1. Allowable shear values for gypsum board panels are obtained by taking the nominal unit shear capacities in SDPWS-2008 Table 4.3C and dividing by the ASD safety factor of 2.0. Allowable shear values for wood structural panels are obtained by taking the nominal unit shear capacities in SDPWS-08 Table 4.3A Wind v_w values and dividing by the ASD safety factor of 2.0.
2. Fasteners for gypsum board are No. 6-1¼-inch long drywall screws (Type W or S). Where the “W” stands for course *Wood* threads and the “S” stands for fine *Steel* threads. Both screw types may be used, but the course wood threads are easier to install in wood studs as compared with the fine threads.

Fasteners for wood structural panels are 8d common nails with 1 ⅜-inch minimum penetration into the framing member.
3. The first number is the fastener spacing at the panel edges and the second number is the fastener spacing along intermediate (field) members.
4. The wall length in the transverse direction has two 29.0-foot-long walls in the same line for a total of 58.0 feet.
5. Values for F_{Total} are taken as the controlling forces from Table 20 multiplied by ASD conversion factor of 0.6 to obtain ASD loads.
6. ⅜-inch wood structural panels are used between the 2nd and 3rd floors because the shear values exceed the values for using drywall screws on the gypsum board. The shear values are within the allowable range for using cooler nails. See discussion on the use of cooler nails vs. screws for gypsum board fastening.



14b. Determination of Shear Wall Chord (Boundary) Forces and Members

Table 22. Determination of Shear Wall Chord Member Forces for Typical 29-Foot Party Wall

Level	$0.6 M_{OT}^2$ (ft-k)	ASD P_{D+L} ⁴ (k)	d' ¹ (ft)	d^3 (ft)	ASD Demand Compression
					$C = \frac{M_{OT}}{d} + P_{D+L}$ (k)
Roof	15.60	0.13	0.33	28.33	0.68
6th Floor	42.63	0.81	0.33	28.33	2.31
5th Floor	80.71	1.48	0.33	28.33	4.33
4th Floor	129.41	3.63	0.56	27.88	8.27
3rd Floor	188.13	4.77	0.56	27.88	11.51

Notes for Table 22:

- d' = distance from wall end to the center of the boundary members (see Figure 10). See Table 23 for size and number of the boundary members.
- M_{OT} is the shear wall cumulative shear wall force (see §6c). Lateral forces use values from Table 20 multiplied by ASD conversion factor of 0.6 to obtain ASD forces.
- d is the distance between boundary members (see §6f).
- $P_{D+L} = w(d')^2$
- Determine service loads on typical interior transverse wall: when $d' \times 2$ is less than one half of the stud bay (16-inch stud bay), 8 inches will be used for tributary loads to wall end.

For ASD demand (see §6f):

$$P_{D+L \text{ Roof}} = (96 \text{ plf} + 100 \text{ plf})(0.67 \times 2) = 0.130\text{k}$$

$$P_{D+L \text{ 6thFloor}} = (910 \text{ plf} + 100 \text{ plf})(0.67 \times 2) + P_{\text{Roof}} = 0.810\text{k}$$

$$P_{D+L \text{ 5thFloor}} = ((910 \text{ plf} + 100 \text{ plf})2 + (96 + 100))(0.67 \times 2) = 1.48\text{k}$$

$$P_{D+L \text{ 4thFloor}} = ((910 \text{ plf} + 100 \text{ plf})3 + (96 + 100))(0.67 \times 2) = 3.63\text{k}$$

$$P_{D+L \text{ 3rdFloor}} = ((910 \text{ plf} + 100 \text{ plf})4 + (96 + 100))(0.67 \times 2) = 4.77\text{k}$$

Table 23. Determination of Shear Wall Chord Members

Level	Chord Posts	Total Area	l_e (ft)	C_f	C_p	Bearing Cap. ² (kips)	ASD Demand (kips)	Stability Capacity ⁵ (kips)	D/C Ratio
Roof	2-3x4	17.5	9.625	1.15	0.1632	10.94	0.68	7.88	0.09
6th Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	2.31	7.88	0.29
5th Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	4.33	7.88	0.55
4th Floor	3-4x4	36.8	9.625	1.15	0.1632	22.97	8.27	16.55	0.50
3rd Floor	3-4x4	36.8	9.625	1.15	0.1632	22.97	11.51	16.55	0.70

Notes for Table 23:

1. $C_d = 1.6$

2. Bearing capacity (on sole plate) = $F'_c \perp A C_b$

3. Column bearing factor $C_b = 1.0$

4. Column stability factor $C_p = \frac{1 + (F_{CE}/F_c^*)}{2c} - \sqrt{\left[\frac{1 + (F_{CE}/F_c^*)}{2c} \right]^2 - \frac{F_{CE}/F_c^*}{c}}$

5. Column stability capacity = $F_c C_D C_F C_P A$

Example for three 4x4 posts: $3 \times 5.394 = 16.55$ kips

6. The typical interior stud wall is framed with 4-inch nominal framing studs



14c. Determination of Shear Wall Uplift Forces

Table 24. Determination of Shear Wall Uplift Forces using ASCE 7-10 Load Combinations

Level	M_R (ft-lb)	d (ft)	ASD Wind Uplift	
			$0.6 M_{OT}^4$ (ft-lb)	$\frac{0.6M_{OT} - 0.6M_R}{d}$ (lb)
Roof	65,598	28.33	15,601	0
6th Floor	271,643	28.33	42,629	0
5th Floor	477,688	28.33	80,714	0
4th Floor	683,733	27.88	129,407	0
3rd Floor	889,778	27.88	188,130	0

Notes for Table 24:

1. Basic load combination used to determine uplift force for wind loading is ASCE 7-10 Eq. 2.4.1.7.
2. Since resisting forces are greater than the overturning forces, there aren't any uplift forces.
3. Since the building in this design example is located in SDC A, ASCE 7-10 §11.7.1 states that load combinations for seismic forces need only comply with equations in §2.3 or 2.4 and need not comply with equations in §12.4. In other words Eq. 2.4.1.7 is used for ASD and the S_{DS} coefficient need not be subtracted from the $0.6 \times M_R$. If the building were located in SDC B or C, Eq. 12.4.2.3 would need to be used and, even if wind forces controlled, it may be possible to have higher overturning forces from seismic forces because of inclusion of the negative vertical accelerations.
4. M_{OT} is the shear wall cumulative shear wall force (see §6c). Lateral forces use values from Table 20 multiplied by the ASD conversion factor of 0.6 to obtain ASD forces.

15. Wind and Seismic Forces to Typical Interior Corridor Wall

Table 25. Wind and Seismic Forces to Typical Interior Longitudinal Corridor Wall

Level	ASD Seismic				ASD Wind				Control
	Trib Area ⁴ (ft ²)	w _x (k)	F _x ¹ (lb)	F _{Total} (lb)	Trib Area ³ (ft ²)	p (lb)	F (lb)	F _{Total} (lb)	
Parapet					84	83.16			
Roof	6,000	587	2,935	2,935	140	36.39	7,248	7,248	Wind
6th	6,000	639	3,195	6,130	280	35.58	5,977	13,225	Wind
5th	6,000	647	3,235	9,365	280	34.63	5,818	19,043	Wind
4th	6,000	647	3,235	12,600	280	33.48	5,625	24,668	Wind
3rd	6,000	647	3,235	15,835	280	32.00	5,376	30,044	Wind

Notes for Table 25:

$$1. F_x = 0.01x \left(\frac{\text{Trib Area}}{\text{Total Area}} \right) \times w_x$$

Since this design example is located in SDC A, vertical distribution of forces per ASCE 7-10 §12.8.3 is not necessary. Since the vertical distribution of forces is not necessary, the need to use a two-stage design for the seismic lateral analysis is also not necessary.

- Total area = 12,000 ft²
- Tributary area for wind in transverse direction is the story height × wall spacing, where the tributary width to the corridor walls at the building ends is 16.0 feet. Tributary Area for the Roof Level is one-half the story height × wall spacing plus the parapet × wall spacing. Because of the stepping effect of the units in plan, the two corridor walls resist less than 50 percent of the total wind force in the longitudinal direction.
- With the corridor walls running down the center of the building, the two corridor walls resist 50 percent of the seismic force in the longitudinal direction.
- Lateral force, F, uses values from Table 19A for pressure p multiplied by the ASD conversion factor of 0.6 to obtain ASD values.



15a. Determination of Shear Wall Fastening

Table 26. Determination of Shear Wall Fastening

Level	F _{Total} ⁵ (lb)	Wall Length (ℓ) ⁴ (ft)	Panels Used ⁵	ASD Design				
				$V = \frac{F_{Total}}{l \text{ (No. sides)}}$ (plf)	Wall Sheathed 1 or 2 sides	Allowable Shear ¹	Fastener Edge Spacing ^{2,3}	Blocking
Roof	7,248	194	5/8-in Gypsum Board	37	1	70	8/12	Unblocked
6th Floor	13,225	194	5/8-in Gypsum Board	68	1	70	8/12	Unblocked
5th Floor	19,043	194	3/8-in Wood Structural Panel	98	1	203	6	Blocked
4th Floor	24,668	194	3/8-in Wood Structural Panel	127	1	203	6	Blocked
3rd Floor	30,044	194	3/8-in Wood Structural Panel	155	1	203	6	Blocked

Notes for Table 26:

1. Allowable shear values for gypsum board panels are obtained by taking the nominal unit shear capacities in SDPWS-2008 Table 4.3C and dividing by the ASD safety factor of 2.0. Allowable shear values for wood structural panels are obtained by taking the nominal unit shear capacities in SDPWS-2008 Table 4.3A Wind v_w values and dividing by the ASD safety factor of 2.0.
2. Fasteners for gypsum board are No. 6-1¼-inch-long drywall screws (Type W or S), where the “W” stands for course *Wood* threads and the “S” stands for fine *Steel* threads (metal studs). Both screw types may be used but the course wood threads are easier to install in wood studs as compared with the fine threads.

Fasteners for wood structural panels are 8d common nails with 1 3/8-inch minimum penetration into the framing member.
3. The first number is the fastener spacing at the panel edges and the second number is the fastener spacing along intermediate (field) members.
4. Wall length for the corridor walls is the total wall length for the corridor walls on both sides of the corridor, where only the longer walls are considered. The corridor walls are considered as one line of resistance. The gypsum board shear wall at the corridors only uses the corridor side for shear resistance and not the unit side, since there are shower tubs and toilet fixtures on that side.
5. 3/8-inch wood structural panels are used between the 2nd and 5th floors because the shear values exceed the values for using drywall screws on the gypsum board. The shear values are within the allowable range for using cooler nails. See discussion on use of cooler nails vs. screws for gypsum board fastening.

15b. Determination of Shear Wall Chord (Boundary) Forces and Members

Table 27. Determination of Shear Wall Chord Member Forces for Typical 17.5-Foot Corridor Wall

Level	$0.6 M_{OT}^2$ (ft-k)	ASD P_{D+L}^4 (k)	d'^1 (ft)	d^3 (ft)	ASD Demand Compression
					$C = \frac{M_{OT}}{d} + P_{D+L}$ (k)
Roof	6.54	0.204	0.33	16.83	0.59
6th Floor	18.47	0.470	0.33	16.83	1.57
5th Floor	35.65	0.736	0.33	16.83	2.85
4th Floor	57.90	1.003	0.33	16.83	4.44
3rd Floor	85.00	1.269	0.33	16.83	6.32

Notes for Table 27:

- d' = distance from wall end to the center of the boundary member (see Figure 10). See Table 23 for size and number of boundary members.
- M_{OT} is the shear wall cumulative shear wall force (see §6c) as determined by proportioning the lateral force for the entire line at the actual wall length multiplied by the ASD conversion factor of 0.6 to obtain ASD forces. The wall length used in Table 27 is 17.50 feet long.

$$F_{wall} = F_{total} \times \left(\frac{\text{wall length}}{\text{total wall length}} \right) \times 0.6$$

- d is the distance between boundary members (see §6f).
- $P_{D+L} = W_{plf} (d')^2$

Determine service loads on typical corridor walls in the longitudinal direction: when $d' \times 2$ is less than one half of the stud bay (16-inch stud bay), 8 inches will be used for tributary loads to wall end.

Dead loads:

$$W_{Roof} = (28.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 119.0 \text{ plf}$$

$$W_{Floor} = (30.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 128 \text{ plf}$$

$$W_{wall} = 10.0 \text{ psf} (10.0 \text{ ft}) = 100.0 \text{ plf}$$

Live loads:

$$W_{Roof} = (20.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 85.0 \text{ plf}$$

$$W_{Floor} = (40.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 170 \text{ plf}$$



Dead + live loads:

$$W_{\text{Roof}} = (28.0 \text{ psf} + 20.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 204.0 \text{ plf}$$

$$W_{\text{Floor}} = (30.0 \text{ psf} + 40.0 \text{ psf}) \left(\frac{8.5 \text{ ft}}{2} \right) = 297.5 \text{ plf}$$

$$W_{\text{Wall}} = 10.0 \text{ psf} (10.0 \text{ ft}) = 100.0 \text{ plf}$$

Table 28. Determination of Shear Wall Chord Members

Level	Chord Posts	Total Area	ℓ_e (ft)	C_f	C_p	Bearing Cap. (kips)	ASD Demand (kips)	Stability Capacity (kips)	D/C Ratio
Roof	2-3x4	17.5	9.625	1.15	0.1632	10.94	0.59	7.88	0.08
6th Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	1.57	7.88	0.20
5th Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	2.85	7.88	0.36
4th Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	4.44	7.88	0.56
3rd Floor	2-3x4	17.5	9.625	1.15	0.1632	10.94	6.32	7.88	0.80

Notes: See Table 23 for notes

15c. Determination of Shear Wall Uplift Forces

Table 29. Determination of Shear Wall Uplift Forces using ASCE 7-10 Load Combinations

Level	M_R (ft-lb)	d (ft)	$0.6 M_{OT}^4$ (ft-lb)	ASD Wind Uplift
				$\frac{M_{OT} - 0.6M_R}{d}$ (lb)
Roof	46,550	16.83	6,538	0
6th Floor	107,417	16.83	18,468	0
5th Floor	168,284	16.83	35,647	0
4th Floor	229,152	16.83	57,899	0
3rd Floor	290,019	16.83	85,000	0

Notes for Table 29:

1. Basic load combination used to determine uplift force for wind loading is ASCE 7-10 Eq. 2.4.1.7.
2. Since resisting forces are greater than the overturning forces, there aren't any uplift forces.
3. Since the building in this design example is located in SDC A, ASCE 7-10 §11.7.1 states that load combinations for seismic forces need only comply with equations in §2.3 or 2.4 and need not comply with equations in §12.4. In other words, Eq. 2.4.1.7 is used for ASD and the S_{DS} coefficient need not be subtracted from the $0.6 \times M_R$. If the building were located in SDC B or C, Eq. 12.4.2.3 would need to be used and, even if wind forces controlled, it may be possible to have higher overturning forces from seismic forces because of inclusion of the negative vertical accelerations.
4. M_{OT} is the shear wall cumulative shear wall force (see §6c). Lateral forces use values from Table 25 multiplied by the ASD conversion factor of 0.6 to obtain ASD forces.

References

- American Wood Council, *Design for Code Acceptance: Fire-Rated Wood-Frame and Floor/Ceiling Assemblies*, 2008, Washington, DC
- American Wood Council, *National Design Specification® (NDS®) for Wood Construction*, 2012, Washington, DC
- APA – The Engineered Wood Association, *Design/Construction Guide – Diaphragms and Shear Walls*, Report 105, 1997, Tacoma, WA
- APA – The Engineered Wood Association, *Diaphragms and Shear Walls*, 2007, Tacoma, WA
- Bendsten, B.A. and W.L. Galligan, 1979, *Mean and Tolerance Limit Stresses and Stress Modeling for Compression Perpendicular to Grain in Hardwood and Softwood Species*, Research Paper FPL 337, US Department of Agriculture Forest Service, Forest Products Laboratory, Madison, WI
- Bendsten, B.A. and W.L. Galligan, *Modeling and Stress-Compression Relationships in Wood in Compression Perpendicular to Grain*, Vol. 29, No. 2: Pg 42-48, 1979, US Department of Agriculture, Forest Products Research Society (Forest Products Society) Forest Products Journal, Madison, WI
- Breyer, Donald E., Kenneth J. Fridley, David G. Pollack, Jr. and Kelly E. Cobeen, *Design of Wood Structures ASD/LRFD*, 2007, McGraw-Hill Book Co., New York, NY
- Building Seismic Safety Council, *NEHRP Recommended Provisions for Seismic Regulations for New Buildings and Other Structures (FEMA 450)*, 2003, Washington, DC
- Churchill, J.E., *Nonstructural Provisions for Multi-Story Wood-Framed Buildings – 2010 California Building Code (CBC)*, 2011, Wood Products Council Workshop
- Commins, Alfred D., *Rod Tie-Down Systems, Part 5-Inspection*, Structure Magazine, August 2008, National Council of Structural Engineers Associations (NCSEA)
- Faherty, Keith F. and Thomas G. Williamson, *Wood Engineering Construction Handbook*, 1995, McGraw-Hill, Washington, DC
- Forest Products Society, *Wood Handbook – Wood as an Engineering Material*, 1999, Madison, WI
- Ghosh, Avik, Steve Pryor and Ricardo Arevalo, *Multi-Story Light-Frame Construction: Understanding Tiedown Systems*, Structure Magazine, June 2006, NCSEA
- Haygreen, J.G. and Bowyer, J.L., *Forest Products and Wood Science – An Introduction*, 1989, University of Iowa Press, Ames, IA
- International Code Council, *International Building Code*, 2012, Falls Church, VA
- Knight, Brian, *High Rise Wood Frame Construction*, Structure Magazine, June 2006, NCSEA
- Matteri, Dominic, *5-over-1 High-Rise Podium Structures*, 2009, Wood Solutions Fair Presentation
- Nelson, Ronald F, *Design Guidelines for Continuous Tie-Down Systems for Wood Panel Shear Walls in Multi Story Structures*, 2011 (Draft)
- Nelson, Ronald F. and Patel, Sharad T., *Continuous Tie-Down Systems for Wood Panel Shear Walls in Multi Story Structures*, Structure Magazine, March 2003, NCSEA
- Kerr, Stephen, John P. Kiland, John W. Lawson, Douglas S. Thompson, *Structural/Seismic Design Manual*, Vol 2, 2006, Structural Engineers Association of California. Sacramento, CA
- Schmid, Ben L., *Three-Story Wood Apartment Building – 1994 Northridge Earthquake Buildings Case Studies Project*, 1996, Seismic Safety Commission, State of California, Sacramento, CA
- SEAOC Seismology Committee, *Anchor Bolts in Light-Frame Construction at Small Edge Distances, The SEAOC Blue Book: Seismic Design Recommendations*, 2009, Structural Engineers Association of California, Sacramento, CA
- SEAOC Seismology Committee, *Light-Frame Wall Hold-downs, The SEAOC Blue Book: Seismic Design Recommendations*, 2008, Structural Engineers Association of California, Sacramento, CA
- SEAOC Seismology Committee (2007), *Wood Framed Shear Walls with Openings*, May 2007, The SEAOC Blue Book: Seismic Design Recommendations, Structural Engineers Association of California, Sacramento, CA
- Shiotani, S., D. Hohbach, J. Roberts, *Lateral System for Multi-Unit Construction*, 2011, Wood Products Council Workshops
- Simpson, William T., *Equilibrium Moisture Content of Wood in Outdoor Locations in the United States and Worldwide, Res. Note FPL-RN-0268*, 1998, Forest Products Laboratory, Madison, WI
- Western Wood Products Association (WWPA), *Tech Notes Report No. 10-Shrinkage Calculations for Multi-Story Wood Frame Construction*, 2002, Portland, OR
- WWPA, *Dimensional Stability of Western Lumber*, 1990, Portland, OR

Acknowledgements

The author would like to thank the following individuals, who are both from private practice and the wood industry, for providing the reviews and comments that helped make this publication possible:

Ricardo Arevalo, SE; Kevin Cheung, PhD, PE; Ed Chin, PE; James Churchill, PE;
Michael Cochran, SE; Brad Douglas, PE; Rick Fine, SE; Doug Hohbach, SE;
Michelle Kam-Biron, SE; Phil Line, PE; Emory Montague, SE; Bill Nelson, SE;
Rawn Nelson, SE; Ben Schmid, SE; Tom VanDorpe, SE; and Tom Williamson, PE

Suggestions for Improvement

Comments and suggestions for improvement are welcome and should be e-mailed to WoodWorks at info@woodworks.org.

About WoodWorks

Free design and engineering support for wood buildings

WoodWorks provides free resources related to the code-compliant design, engineering and construction of non-residential and multi-family wood buildings. For project assistance, visit woodworks.org or email help@woodworks.org.



WoodWorksTM
WOOD PRODUCTS COUNCIL

