

BUILT-UP ROOFING - CLASS A, B, OR C PER LOCAL CODE REQUIREMENTS



WOOD STRUCTURAL PANEL ROOF SHEATHING, SEE STRUCTURAL DRAWINGS

MIN. 9 1/2" DEEP I-JOISTS AT 24" O.C., SLOPED PER PLAN, SEE STRUCTURAL DRAWINGS

BATT INSULATION PER THERMAL REQUIREMENTS


1 LAYER 1/2" MIN. GYP. BD..

MIN. 9 1/2" DEEP I-JOISTS AT 24" O.C., SLOPED PER PLAN, SEE STRUCTURAL DRAWINGS

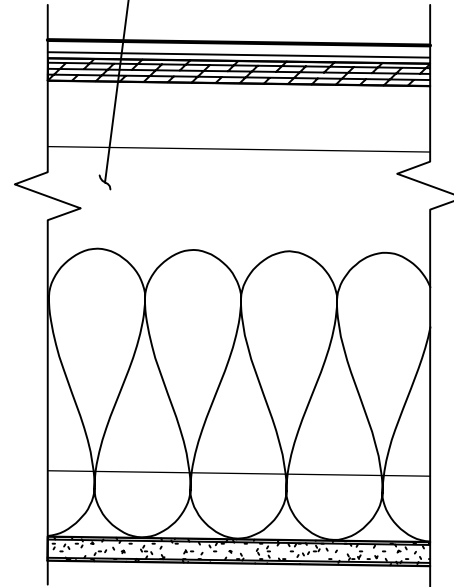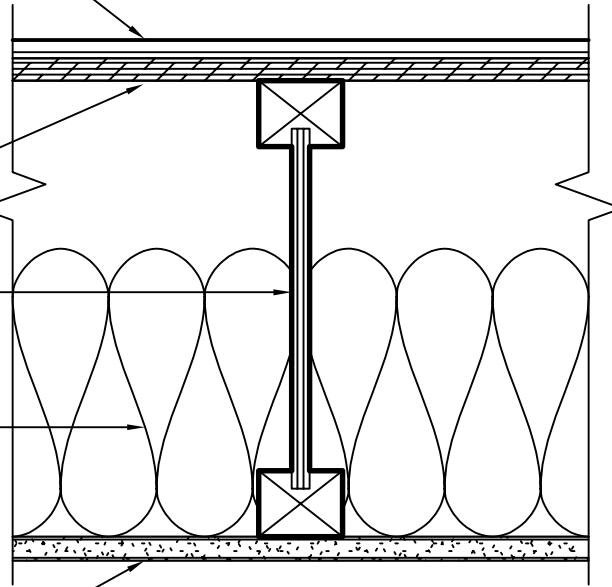

VIEW PERPENDICULAR TO FRAMING

VIEW PARALLEL TO FRAMING



## NON-RATED I-JOIST ROOF - SLOPED FRAMING

3" = 1'-0"