

BUILT-UP ROOFING - CLASS A, B, OR C PER LOCAL CODE REQUIREMENTS


MIN. 15/32" WOOD STRUCTURAL PANEL SUBFLOOR, SEE STRUCTURAL DRAWINGS

MIN. 9 1/2" DEEP I-JOISTS AT 24" O.C., SLOPED PER PLAN, SEE STRUCTURAL DRAWINGS


BATT INSULATION PER THERMAL REQUIREMENTS

2 LAYERS 1/2" TYPE 'X' GYP. BD. ON RESILIENT CHANNELS AT 16" O.C.

MIN. 9 1/2" DEEP I-JOISTS AT 24" O.C., SLOPED PER PLAN, SEE STRUCTURAL DRAWINGS

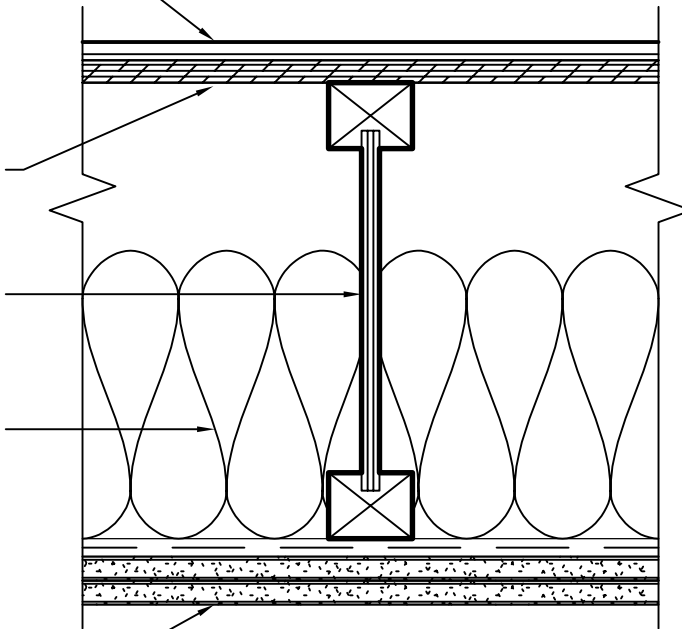


VIEW PERPENDICULAR TO FRAMING

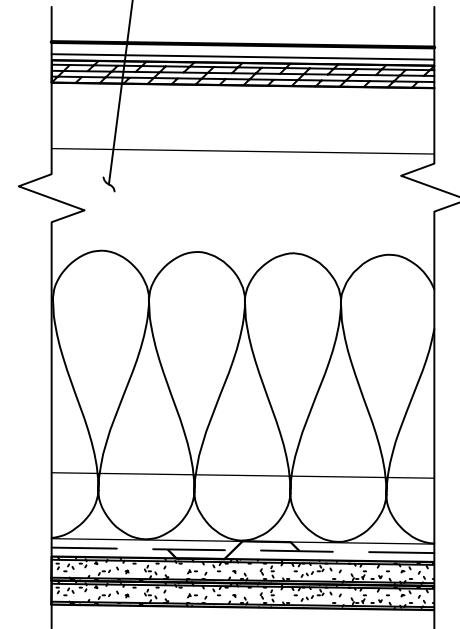

VIEW PARALLEL TO FRAMING

1 HOUR RATED PER UL DESIGN No. L518



1 HOUR I-JOIST ROOF - SLOPED FRAMING

3" = 1'-0"